For Non-Health Hazard Applications

Job Name	Contractor
Job Location	Approval
Engineer	Contractor's P.O. No.
Approval	Representative

Series 774DCDA Double Check Detector Assemblies

Sizes 21/2" - 12" (65 - 300mm)


Series 774DCDA Double Check Detector Assemblies are designed for use in accordance with water utility non-health hazard containment requirements. It is mandatory to prevent the reverse flow of fire protection system substances, i.e., glycerin wetting agents, stagnant water and water of non-potable quality from being pumped or siphoned into the potable water supply.


Features

- Torsion spring check valve provides low head loss
- · Short lay length is ideally suited for retrofit installations
- Stainless steel body is half the weight of competitive designs reducing installation and shipping cost
- Stainless steel construction provides long term corrosion protection and maximum strength
- Single top access cover with two-bolt grooved style coupling for ease of maintenance
- Thermoplastic and stainless steel check valves for trouble-free operation
- No special tools required for servicing
- Compact construction allows for smaller vaults and enclosures
- Furnished with $\frac{5}{8}$ " x $\frac{3}{4}$ " (16x19mm) bronze meter (gpm or cfm)
- Detects underground leaks and unauthorized water use
- May be installed horizontal or vertical "flow up" position

Specifications

A Double Check Detector Assembly shall be installed on fire protection systems when connected to a potable water supply. Degree of hazard present is determined by the local authority having jurisdiction. The assembly shall consist of two positive seating check valves located between two resilient seated shutoffs with a hydraulically balanced bypass line and four test cocks. The main valve body shall be manufactured from 300 Series stainless steel to provide corrosion resistance. The check valves shall be of thermoplastic construction with stainless steel hinge pins, cam arm and cam bearing. The check valves shall utilize a single torsion spring design to minimize pressure drop through the assembly. The check valves shall be modular and shall seal to the main valve body by the use of an O-ring. There shall be no brass or bronze parts used within the check valve assembly. The check valve seats shall be of molded thermoplastic construction. The use of seat screws as a retention method is prohibited. All internal parts shall be accessible through a single cover on the valve assembly. The valve cover shall be held in place through the use of a single grooved style two-bolt coupling. The bypass line shall be hydraulically sized to accurately measure low flow. The bypass line shall consist of a meter, a small diameter double check assembly with test cocks and isolation valves. The bypass line double check valve shall have two independently operating modular poppet check valves, and top mounted test cocks. The assembly shall be a Watts Series 774DCDA.



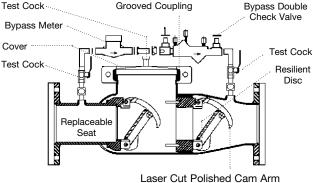

Available Models

Suffix:	
LF –	without shutoff valves
0SY –	UL/FM outside stem and yoke resilient seated gate valves
*OSY FxG –	flanged inlet gate connection and grooved outlet gate connection
*OSY GxF –	grooved inlet gate connection and flanged outlet gate connection
*OSY GxG –	grooved inlet gate connection and grooved outlet gate connection
CFM –	cubic feet per minute meter
GPM –	gallons per minute meter
Post indicator	grooved NRS gate valves - consult factory* plate and operating nut available - consult factory* ry for dimensions

Now Available WattsBox Insulated Enclosures. For more information, send for literature ES-WB.

NOTICE

Inquire with governing authorities for local installation requirements

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.



Materials

All internal metal parts: 300 Series stainless steel, Main valve body: 300 Series stainless steel, Check assembly: Noryl® Flange dimensions in accordance with AWWA Class D.

Pressure - Temperature

Temperature Range: 33°F - 110°F (0.5°C - 43°C) continuous Pressure Range: 175psi (12.1 bar)

Capacity

Flow curves as tested by Underwriters Laboratory per UL 1469, 1996 * Rated flow **UL Tested


Standards

AWWA C510, CSA B64.5

Approvals





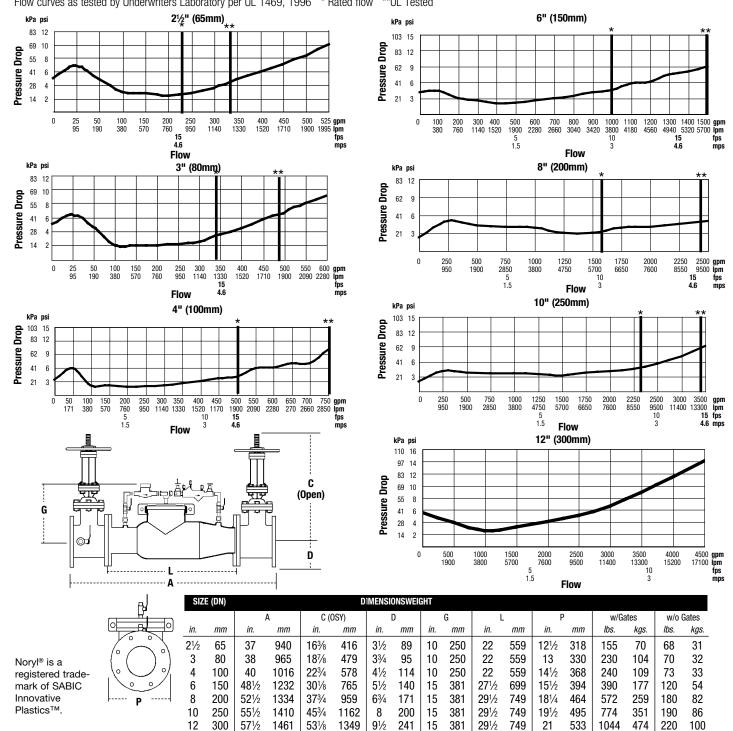



USA: Tel: (978) 689-6066 • Fax: (978) 975-8350 • Watts.com Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com