


ITEM: EF-AZ107WH EF-AZ108WH ANZZI EXHAUST FAN INSTALLATION & OPERATION MANUAL V1.1 03/01/2024

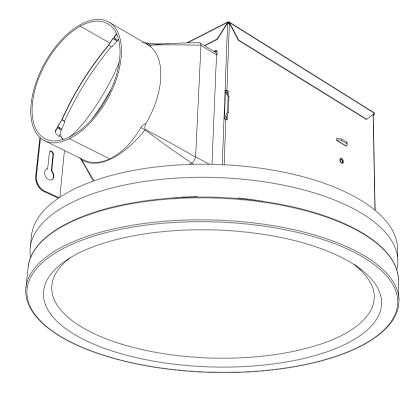

DON'T WAIT! REGISTER NOW!

Register your product within 90 days to ensure your product is recognized as an official purchase and is eligible for warranty coverage.

Mail in the completed registry card (Pg. 2) or register online at https://register.anzzihome.com/register/.

PRODUCT REGISTRATION*

IMPORTANT: Warranty will not be recognized unless product is registered.

We offer two options to register your product.

1. Register online at https://register.anzzihome.com/register/ or Scan the QR code below. Registering online is fast, secure, and ensures we receive your information.




2. Complete, cut out, and mail the registration card below. Returning this registration card will ensure your product's warranty and allow us to process any warranty claims.

0

CUT ALONG

Mail the card to: 5701 NW 35 Avenue, Miami, FL 33142

Product Registration	on Card		
Name	Address		
City	StateZip		
Phone	Email		
Date of Purchase			
Installer's Name	Phone		
I have read the Owner's Manual carefully and understand and agree that any installation, operation or maintenance of the product must be done strictly in accordance with instructions and guidelines contained in the owner's manual and installation guide.			
Signature	Date		
<u>.</u>			
Need help?	For technical support call 305-614-4070 or visit us at www.ANZZI.com		

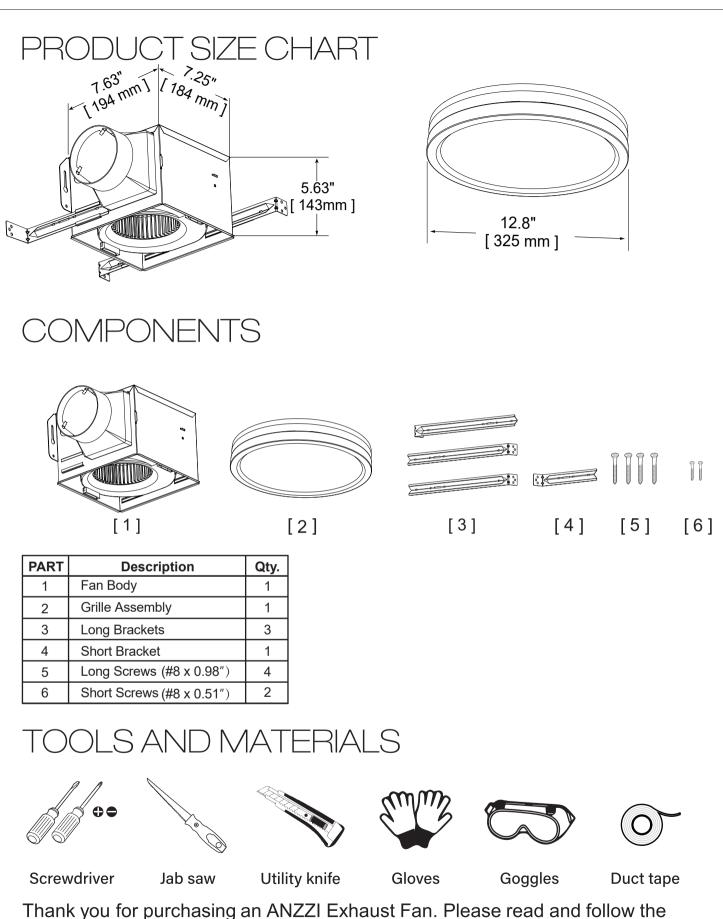

Thank you for purchasing an ANZZI Exhaust Fan. Please read and follow the installation and operation instructions carefully, to ensure the long life and reliable operation of this appliance. FAILURE TO DO SO COULD CAUSE PROPERTY DAMAGE, SERIOUS INJURY, OR DEATH. Please keep this manual for future reference.

SAFETY PRECAUTIONS READ AND SAVE THESE INSTRUCTIONS

TO REDUCE THE RISK OF FIRE, ELECTRIC SHOCK, OR INJURY TO PERSONS, OBSERVE THE FOLLOWING:

- Use this unit only in the manner intended by the manufacturer. If you have questions, contact the manufacturer.
- Before servicing or cleaning unit, switch power off at service panel and lock the switch to prevent power from being switched on accidentally. When the switch cannot be locked, securely fasten a prominent warning device, such as a tag, to the service panel.
- Installation work and electrical wiring must be done by qualified person(s) in accordance with all applicable codes and standards, including fire-rated construction.
- When cutting or drilling into wall or ceiling, do not damage electrical wiring and other hidden utilities.
- Ducted fans must always be vented to the outdoors.

- Sufficient air is needed for proper combustion and exhausting of gases through the flue (chimney) of fuel burning equipment to prevent back drafting. Follow the heating equipment manufacturer's guideline and safety standards such as those published by the National Fire Protection Association (NFPA), and the American Society for Heating, Refrigeration and Air Conditioning Engineers (ASHRAE), and the local code authorities.
- If this unit is to be installed over a tub or shower, it must be marked as appropriate for the application and be connected to a GFCI (Ground Fault Circuit Interrupter) protected branch circuit.
- To Reduce The Risk Of Fire Or Electric Shock, Do Not Use This Fan With Any Solid-State Speed Control Device.
- NEVER place a switch where it can be reached from a tub or shower.
- This unit must be grounded.

- For General Ventilating Use Only. Do Not Use To Exhaust Hazardous Or Explosive Materials And Vapors.
- IN USA: INSTALL FAN AT LEAST 7 FEET (2.1M) ABOVE FLOOR. IN CANADA: INSTALL FAN AT LEAST 8.2 FEET (2.5M) ABOVE FLOOR.
- This product is designed for installation in ceilings up to a 12/12 pitch (45 degree angle). Duct connector must point up. DO NOT MOUNT THIS PRODUCT IN A WALL.
- To avoid motor bearing damage and noisy and/or unbalanced impellers, keep drywall spray, construction dust, etc. off power unit.

- Not for use in cooking area. (See Fig 1)
- Please read specification label on product for further information and requirements.

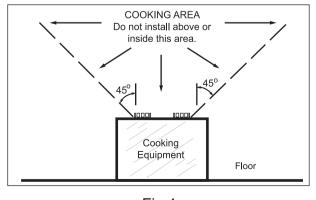


Fig 1

NOTICE

- Follow all local electrical and safety codes, as well as the National Electrical Code (NEC) and the Occupational Safety and Health Act (OSH Act).
- Always disconnect the power source before working on or near the ventilating fan, motor or junction box.
- Make sure that the electric service supply voltage is AC 120V, 60Hz.
- Protect the power cord from sharp edges, oil, grease, hot surfaces, chemicals or other objects.

- Do not kink the power cord.
- Do not install the unit where ducts are configured as shown in Fig 2.

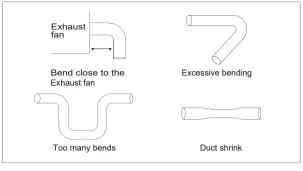



Fig 2

FEATURES AND SETTINGS

This section is for EF-AZ108WH only except the LED light and night light.

- Turning the " H " adjuster will change the humidity sensing level. When the detected humidity reaches the pre-set level, the fan will be switched to the maximum speed.
- The "S" adjuster controls the suction of air. When the humidity is lower than the sensor setting, the fan will keep working at maximum speed until the pre-set time is up. Then the fan will operate at the speed pre-set by this adjuster.
- The "Toggle switch " will change the time of the fan working at maximum speed after the humidity of room is lower than the pre-set humidity sensing level. (Fig 3)
- The "Toggle switch " on the side of the light can switch the light between 3 different color temperatures to match the other lighting in your room. (Fig 4)
- These exhaust fans are integrated with a night light. They can be switched on by using the light switch. When the light is on, turn the light switch off, then turn it on again in 10 seconds to switch the light to night light.

Note: When the light or night light is turned off for 10 seconds or longer, using the switch will turn on the main light.








Fig 4

FEATURES AND SETTINGS

HUMIDITY SENSING LEVEL

- Install an Adjusting Knob to the "H" adjuster with the arrow on it pointing to 80% to adjust the humidity sensing level.
- The humidity sensing level is pre-set at 80%. When the detected humidity reaches the pre-set level, the fan will be switched to the maximum speed.

SPEED ADJUSTMENT

Install an Adjusting Knob to the "S" adjuster with the arrow on it pointing to Max to adjust the CFM of the air suction when the maximum speed time of the fan is up. If the adjuster is turned to the "OFF" setting, the fan will stop working after the time set for maximum speed is up.

TOGGLE SWITCH

 There are two toggles on the toggle switch. Adjust the toggles as shown in fig 3 to adjust the delay time. The timer is pre-set to 30 minutes. When the humidity is lower than the sensor setting, the fan will maintain its maximum speed until the pre-set time is up.

When installing Humidity and Speed Control Knob, make sure the arrows are pointing to the correct location as picture shows in Fig 3.

INSTALLATION GUIDELINE

- 1. Install this fan in a GFCI protected branch circuit.
- 2. Check area above installation location to be sure that wiring can run to the planned location and that ductwork can be run. Make sure the area is sufficient for proper ventilation.
- 3. Inspect duct work and wiring before proceeding with installation.

Note: Not all parts necessary for the installation of your exhaust fan are included. However, most are available at your local home improvement or hardware store.

- 4. Make sure there is adequate space for installation with 7.63" x 7.25 (duct direction) x 5.63" (Height).
- 5. Install proper insulation around the fan to minimize building heat loss and gain. 4" circular duct is needed for installation. The ducting from this fan to the outside of the building has a strong effect on the air flow, noise and energy use of the fan. Use the shortest, straightest duct routing possible for best performance, and avoid installing the fan with smaller ducts than recommended. Insulation around the ducts can reduce energy loss and inhibit mold growth. Fans installed with existing ducts may not achieve their rated air flow.
- 6. Use a roof cap or wall cap that has a built-in damper to reduce backdrafts.

INSTALLATION EXAMPLE

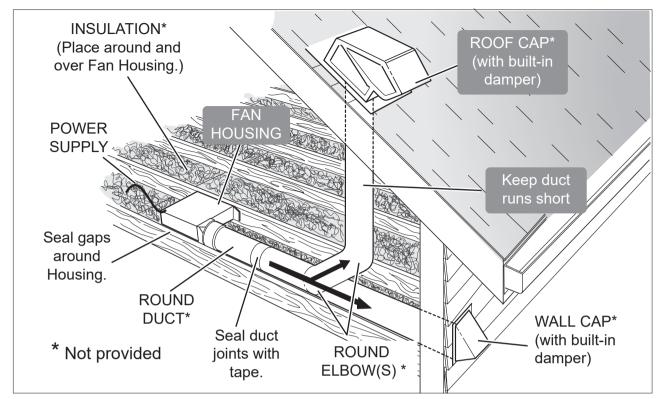


Fig 5

INSTALLATION

Shut down power supply at breaker box before starting installation.

NOTICE


- You may need the help of a second person to install this fan-one person on the attic side and one on the room side.
- Be careful to cut hole to the correct size. If hole is too big, the fan grille will not hide it.
- Make sure there is space with 7.63" x 7.25 (duct direction) x 5.63" (Height).
- This fan can be installed to 7.7" 24" between the joist or to I-joists, standard joists and truss construction.

Step 1 - There are multiple ways to install the fan. Choose the suitable one to follow below. Please check the instructions for ceiling or retrofit installations at page 12.

MOUNTING THE FAN TO THE JOIST, "I" JOIST OR TRUSS DIRECTLY

Notice: Additional framing in 2" X 6" section size would be needed for "I" joist or joist and truss which are less than 6".

- 1. Position and hold the Fan Body [1] to the joist (truss or framing). Make sure the flange of housing is flush to the edge of joist.
- 2. Secure the tabs with Long Screws [5] as figure shows. (Fig 6)







MOUNTING THE FAN TO THE JOIST, "I" JOIST OR TRUSS WITH BRACKETS - 1

- 1. Insert one Long Bracket [3] to the slot at the backside of Fan Body [1] as figure shows. (Fig 7)
- 2. Position and hold the Fan Body [1] to the joist (truss or framing) as figure shows. Make sure the flange of housing is flush to the edge of joist. (Fig 8)
- 3. Secure the flange with Long Screws [5] as figure shows. (Fig 8)
- 4. Secure the Long Bracket [3] to joist with one Long Screw [5]. (Fig.8)
- 5. Install one Short Screw [6] to the hole of the Long Bracket [3] and secure. The hole should be close to the center of Fan Body [1]. (Fig 9)

Notice: You can install Fan Body [1] to the joist against the duct side by following steps above.

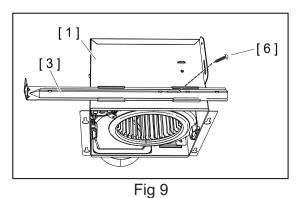





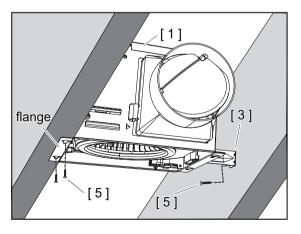


Fig 8

MOUNTING THE FAN TO THE JOIST, "I" JOIST OR TRUSS WITH BRACKETS - 2

- 1. Insert Short Bracket [4] to the slot at the duct side of Fan Body [1] as figure shows. (Fig 10)
- 2. Position and hold the Fan Body [1] to the joist (truss or framing) as figure shows. Make sure the flange of housing is flush to the edge of joist. (Fig 11)
- 3. Secure the flange with Long Screws [5] as figure shows. (Fig 11)
- 4. Secure the Short Bracket [4] to joist with one Long Screw [5]. (Fig 11)
- 5. Install one Short Screw [6] to the hole of the Short Bracket [4] and secure. The hole should be close to the center of the slot. (Fig 12)






Fig 11



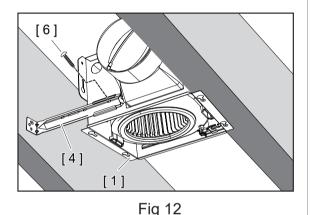

MOUNTING THE FAN TO THE JOIST, "I" JOIST OR TRUSS WITH BRACKETS - 3

- 1. Insert two Long Brackets [3] to the slot at the backside of Fan Body [1] as figure shows. (Fig 13)
- 2. Insert the third Long Bracket [3] to the slot at the duct side of Fan Body [1] as figure shows. (Fig 14)
- 3. Insert the Fan Body [1] between joists.

Note: Make sure the Fan Body [1] is level and perpendicular with the joist, and flush with the surface of the joists which are connected to the ceiling surface. (Fig 14)

- Secure the brackets to joists with Long Screws [5]. (Fig 14)
- Find the hole in the center of overlapped pair of Brackets [3]. Install one Short Screw [6] in the hole, close to the middle of the Fan Body [1]. (Fig 15)
- 6. Install one Short Screw [6] to the hole of the third bracket and secure. The hole should be close to the center of the slot. (Fig 15)





Fig 13

INSTALLAT






Step 2

- Make sure the damper is at the right place and can flip 1 freely. Connect the 4" round ductwork (not provided) to the duct connector, and run the ductwork to a roof or wall cap (not provided).
- 2. Using tape (not included), secure all the ductwork connections so that they are air tight.

Note: Use the shortest, straightest duct routing possible for best performance, and avoid installing the fan with smaller ducts than recommended. Insulation around the ducts can reduce energy loss and inhibit mold growth. Fans installed with existing ducts may not achieve their rated air flow









Fig 16

Step 3

Run 120 VAC house wiring to the location of the fan. Use only UL-approved Wire Nut (not provided) to attach the house wiring to the wiring plate. Refer to the wiring diagram, and connect the wires as shown.

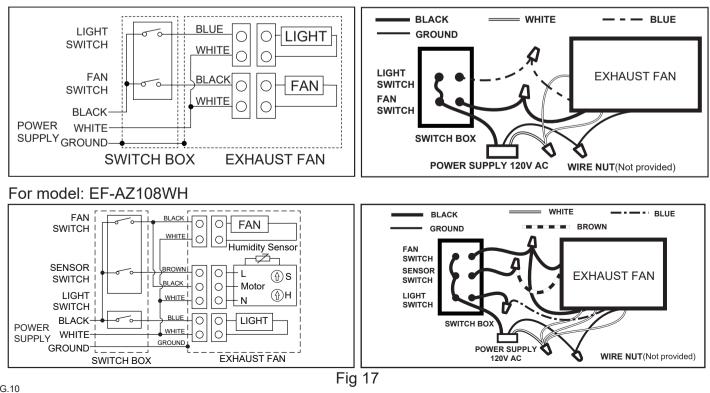

For model: EF-AZ107WH

Step 4

- 1. Install ceiling material to complete the ceiling construction. Then, cut around the fan housing.
- 2. Remove dust from the Fan Body [1] with a vacuum cleaner. Do not use abrasive cloths, steel wool pads, or scouring powders. Never use solvents, thinner or harsh chemicals when cleaning the fan.
- 3. Plug the Light Connector into the receptacle of the Fan Body [1].

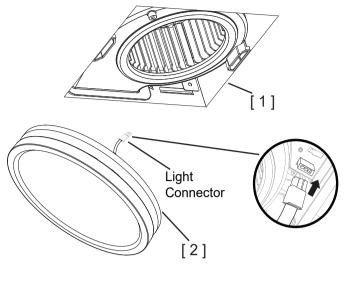


Fig 18

Step 5

1. Pinch the Springs of Grille Assembly [2] on the sides and insert the Springs into the narrow rectangular Slots in Fan Body [1]. Then, push the Grille Assembly [2] towards the ceiling to secure.

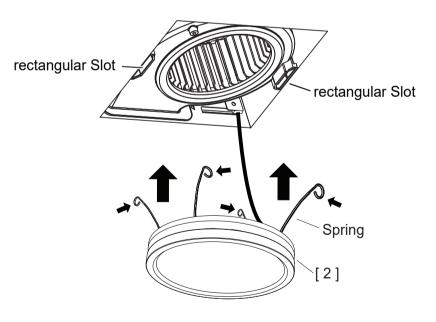


Fig 19

Step 1 - MOUNTING THE FAN TO THE CEILING OR RETROFIT

- 1. Enlarge ceiling opening (if necessary) to 7.25" (parallel to duct direction) by 7.63" (perpendicular to duct direction). (Fig 20)
- 2. Remove the old fan and leave ductwork and wiring in place. (Fig 21)






Fig 20






- Unplug the connection from the wiring panel.
 (Fig 22)
- 4. Unscrew the screws which are holding the blower to the housing. (Fig 22)
- 5. Remove the blower from the fan housing. (Fig 22)

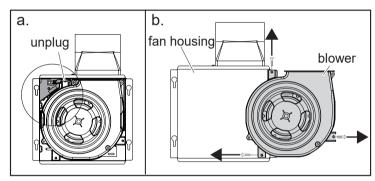



7. Remove the duct connector from the fan housing.

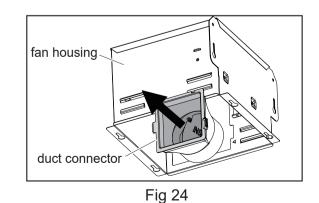

- 6. a. Remove the screw which is holding the wiring panel.
 - b. Remove wiring panel from the fan housing.




Fig 23

- 8. a. Fold one tab flat to the duct side and the other tab to its counter side.
 - b. Use a slot screwdriver to remove the cover on the top of fan housing.




Fig 25

10. Re-install wiring panel and secure with screw.

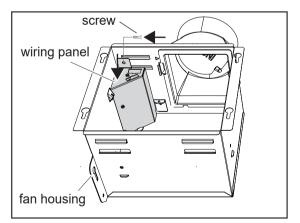


Fig 27

9. Slide the power cable through the hole at the top of fan housing and connect it to wiring panel with appropriate UL approved wire nuts. Connect black to black, white to white, blue line connect to wire from the light switch and green to green or bare wire. See Fig 17.




Fig 26

 Place fan housing in opening so that its bottom edge is flush with finished ceiling. Attach to joist through holes with two Long Screws [5] as figure shows. (Fig 28)

Notice: Use suitable framing for the gap between the fan housing and the joist. Secure the framing to the joist before attaching the fan housing to the framing to avoid noise.





Fig 28


Step 2 - MOUNTING THE FAN TO THE CEILING OR RETROFIT

1. Pull existing ducting through housing discharge opening and tape ducting to duct connector.




Step 3

1. Re-install blower removed in Step 1. Secure blower with screws.






2. Push connector and ducting back through opening until it clips securely in place.



2. Install the connector of blower back to the receptacle again.





See Step 4 & 5 at PG. 11 for Grille Assembly [2] installation.

OPERATING INSTRUCTIONS

\land WARNING

This EXHAUST FAN must be properly installed before it is used.

- 1. Turn on the Light Switch to turn on the LED light. When the light is on, turn the light switch off, then turn it on again in 10 seconds to switch the light to night light. Leave night light turned off for 10 seconds or longer, then use the switch to turn on the main light.
- 2. Turn on the Sensor Switch to start the fan. The fan will operate under pre-set speed. When the humidity of the room reaches the pre-set humidity level, the fan will switch to the maximum speed to exhaust the air. (for EF-AZ108WH)
- 3. When the fan isn't working at the maximum speed, turn on the Fan Switch to adjust the fan to the maximum speed to exhaust the air continously. Turn off the Fan Switch so that the fan goes back to the humidity sensor controlled mode. (for EF-AZ108WH)

CLEANING AND MAINTENANCE

Always disconnect the power source before working on the ventilating fan.

- 1. Pull down the Grille Assembly [2] and squeeze springs to pull it out from the Fan Body [1]. Unplug the Grille Assembly [2] from Fan Body [1].
- 2. Remove dust and dirt from the Fan Body [1] with a vacuum cleaner. Do not use abrasive cloths, steel wool pads, or scouring powders. Never use solvents, thinners or harsh chemicals when cleaning the fan.
- 3. Plug the Grille Assembly [2] back into the receptacle of the Fan Body [1]. Install the Grille Assembly [2] back to the Fan Body [1].

SYMPTOMS	POSSIBLE CAUSE	RECOMMENDED ACTIONS
The fan is not turning on	1. Power off	1. Make sure power supply is on.
	2. Faulty switch	2. Test or replace switch.
	3. Faulty wire connection	3. Check wire in switch box.
The fan seems louder than it should	1. CFM rating is too high for room	 Be sure the CFM rating on the fan matches the size of your room.
	2. Damper not working properly or damaged	 Check damper to ensure it is opening and closing properly. If the damper has become damaged, please call Customer Service.
	3. Bend in duct too close to fan discharge	3. Be sure you do not have any sharp bends in duct closer than 18 in. to the fan discharge.
	4. Fan discharge reduced to fit smaller duct	 Use recommended size ducting to reduce fan noise.
	5. Fan body not securely attached	5. Be sure the fan is securely attached to your ceiling joists.
The fan is not clearing the room	1. Insufficient intake airflow within room	 Be sure a door or window is slightly ajar or opened to allow airflow. The fan is not able to draw air out of the room without enough airflow to draw in from.
	2. Insufficient CFM	2. Be sure the CFM rating on the fan matches the requirements for your room size.

TROUBLE SHOOTING

