

P-D & P-E: DIMENSIONS AND CLEARANCES

NOTE

***ENGINEER / ARCHITECT TO CONSULT WITH CUSTOMER SOLUTIONS TO DETERMINE BRACKET LOCATION FOR SETTING THE DESIRED DEPTH OF WALL SLEEVE INTO WALL.


CLEARANCES

FRONT	0.25" MIN.
RIGHT SIDE	2" MIN.
LEFT SIDE	0"
BOTTOM	8" from the floor

**

A clear and unobstructed passageway (dimension AxB) shall be provided to the unit, in accordance with the requirements of the local authorities having jurisdiction and the National Electrical Code in the United States or CAN/CGA-B149.1 & .2 and the Canadian Electrical Code CSA C22.1 Part 1 (latest edition) in Canada.

• Clearance required is larger for left hand return ducting

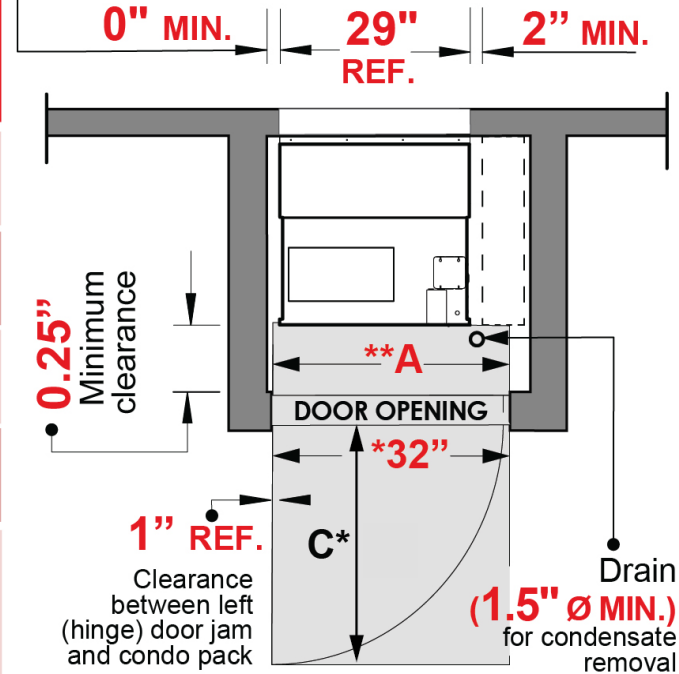

* 32" x C (32.5") unobstructed clearance is required in front of the unit for complete removal of heating and cooling module.

