


ELJ HINGED ACCESS ENCLOSURE

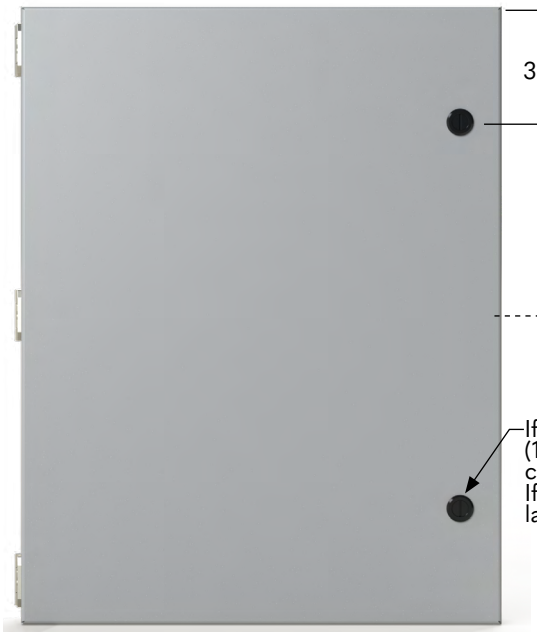


Front View

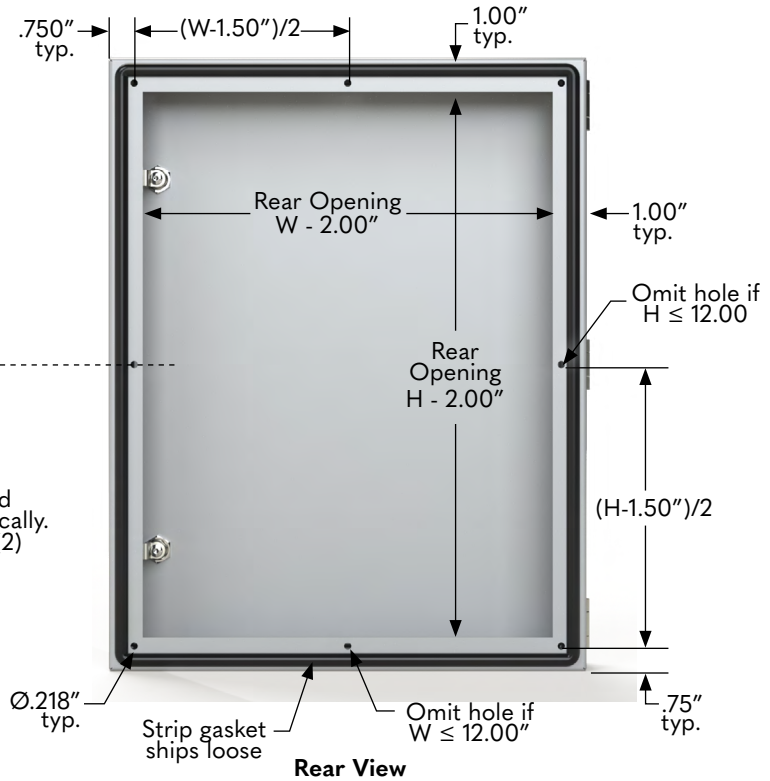

Rear View

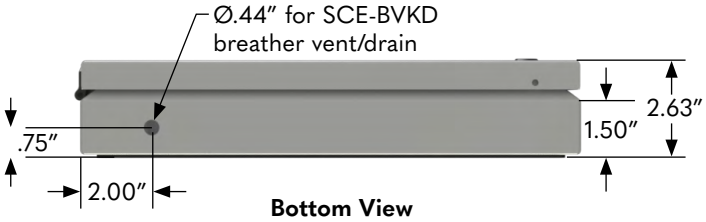

Bottom View

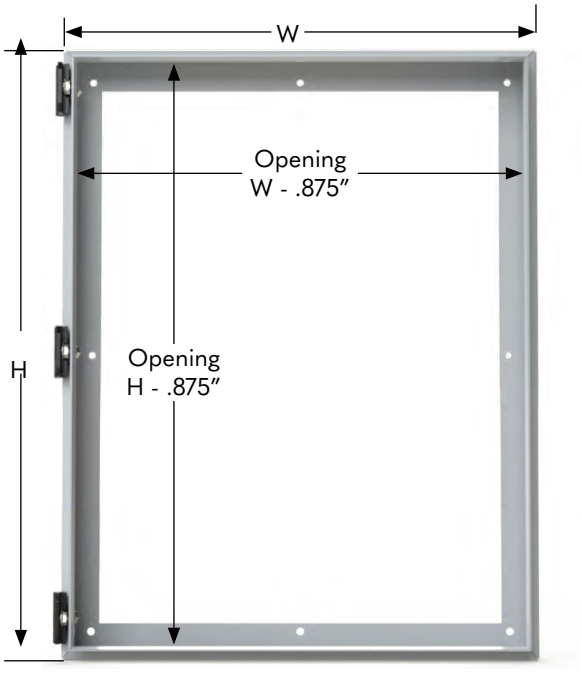

Front View
(Door removed)


	Finish Options				
Catalog Number	SS	LG	05	Height	Width
SCE-HA1010	SS	LG	05	10	10
SCE-HA1014	SS	-	-	10	14
SCE-HA1212	SS	LG	05	12	12
SCE-HA1216	SS	-	-	12	16
SCE-HA1418	SS	-	-	14	18
SCE-HA1620	SS	-	-	16	20
SCE-HA1814	SS	LG	-	18	14
SCE-HA806	SS	-	-	8	6

Torque Specification: 19.2 - 38.4 in-lbs per screw

SAGINAW CONTROL & ENGINEERING

Your Enclosure Source ®

ELJ HINGED ACCESS ENCLOSURE

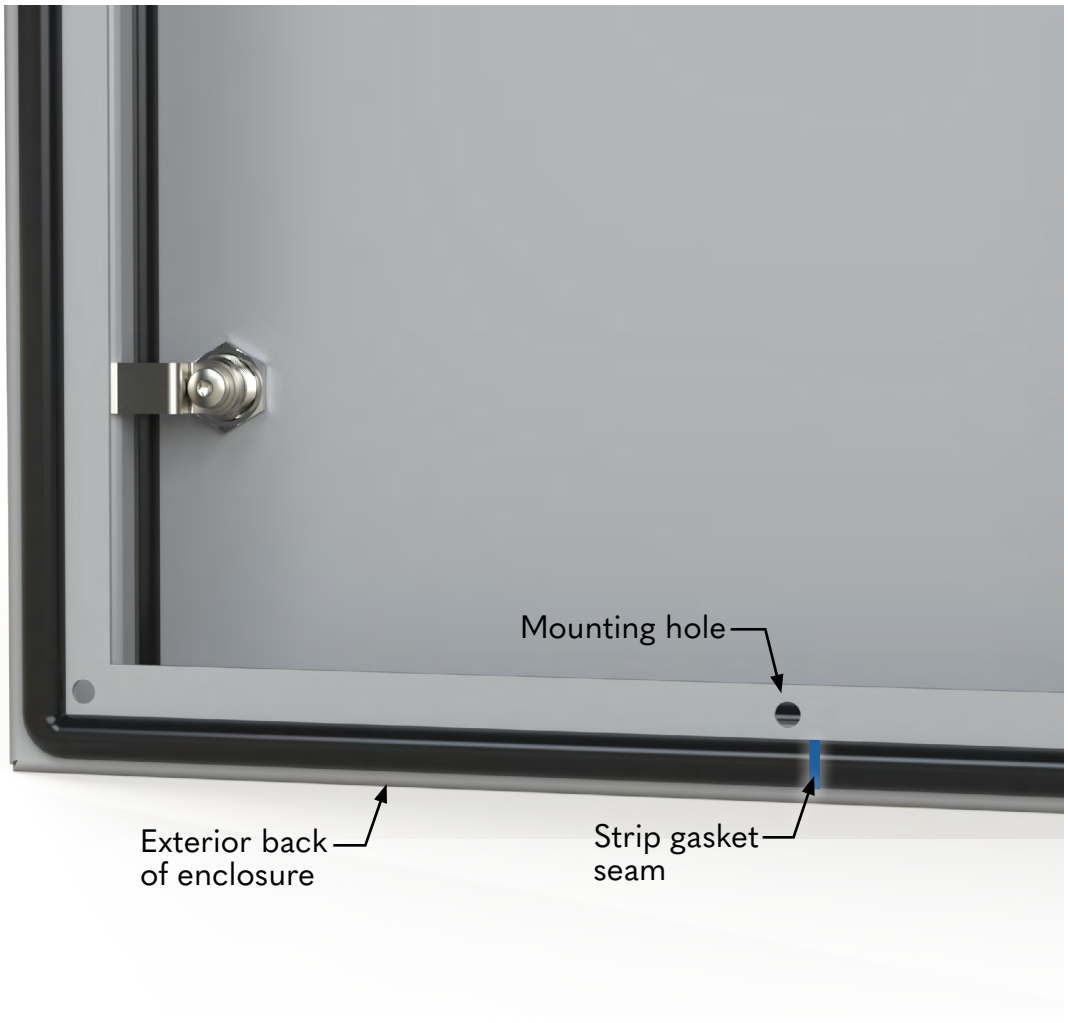

A. Apply strip gasket provided with bolt pack to the exterior back of the enclosure.

B. Start applying the strip gasket centered at the bottom of the enclosure.

C. The strip gasket needs to be applied in one continuous path, on the outside of each mounting hole.

D. End with the strip gasket seam centered at bottom of the enclosure, flush to the starting point.

SAGINAW CONTROL & ENGINEERING

Your Enclosure Source ®