



Applies to HE, HE+, SE, and Sensei Models

Note:

1. Ensure TMV1 check valves are removed. (This will be diverter valve.)
2. Set TMV1 20F below Rinnai temperature setting.
3. TMV2 should be set to desired domestic temperature.
4. For lowest activation flow rate, ensure water heaters are connected with appropriate cascade controls.

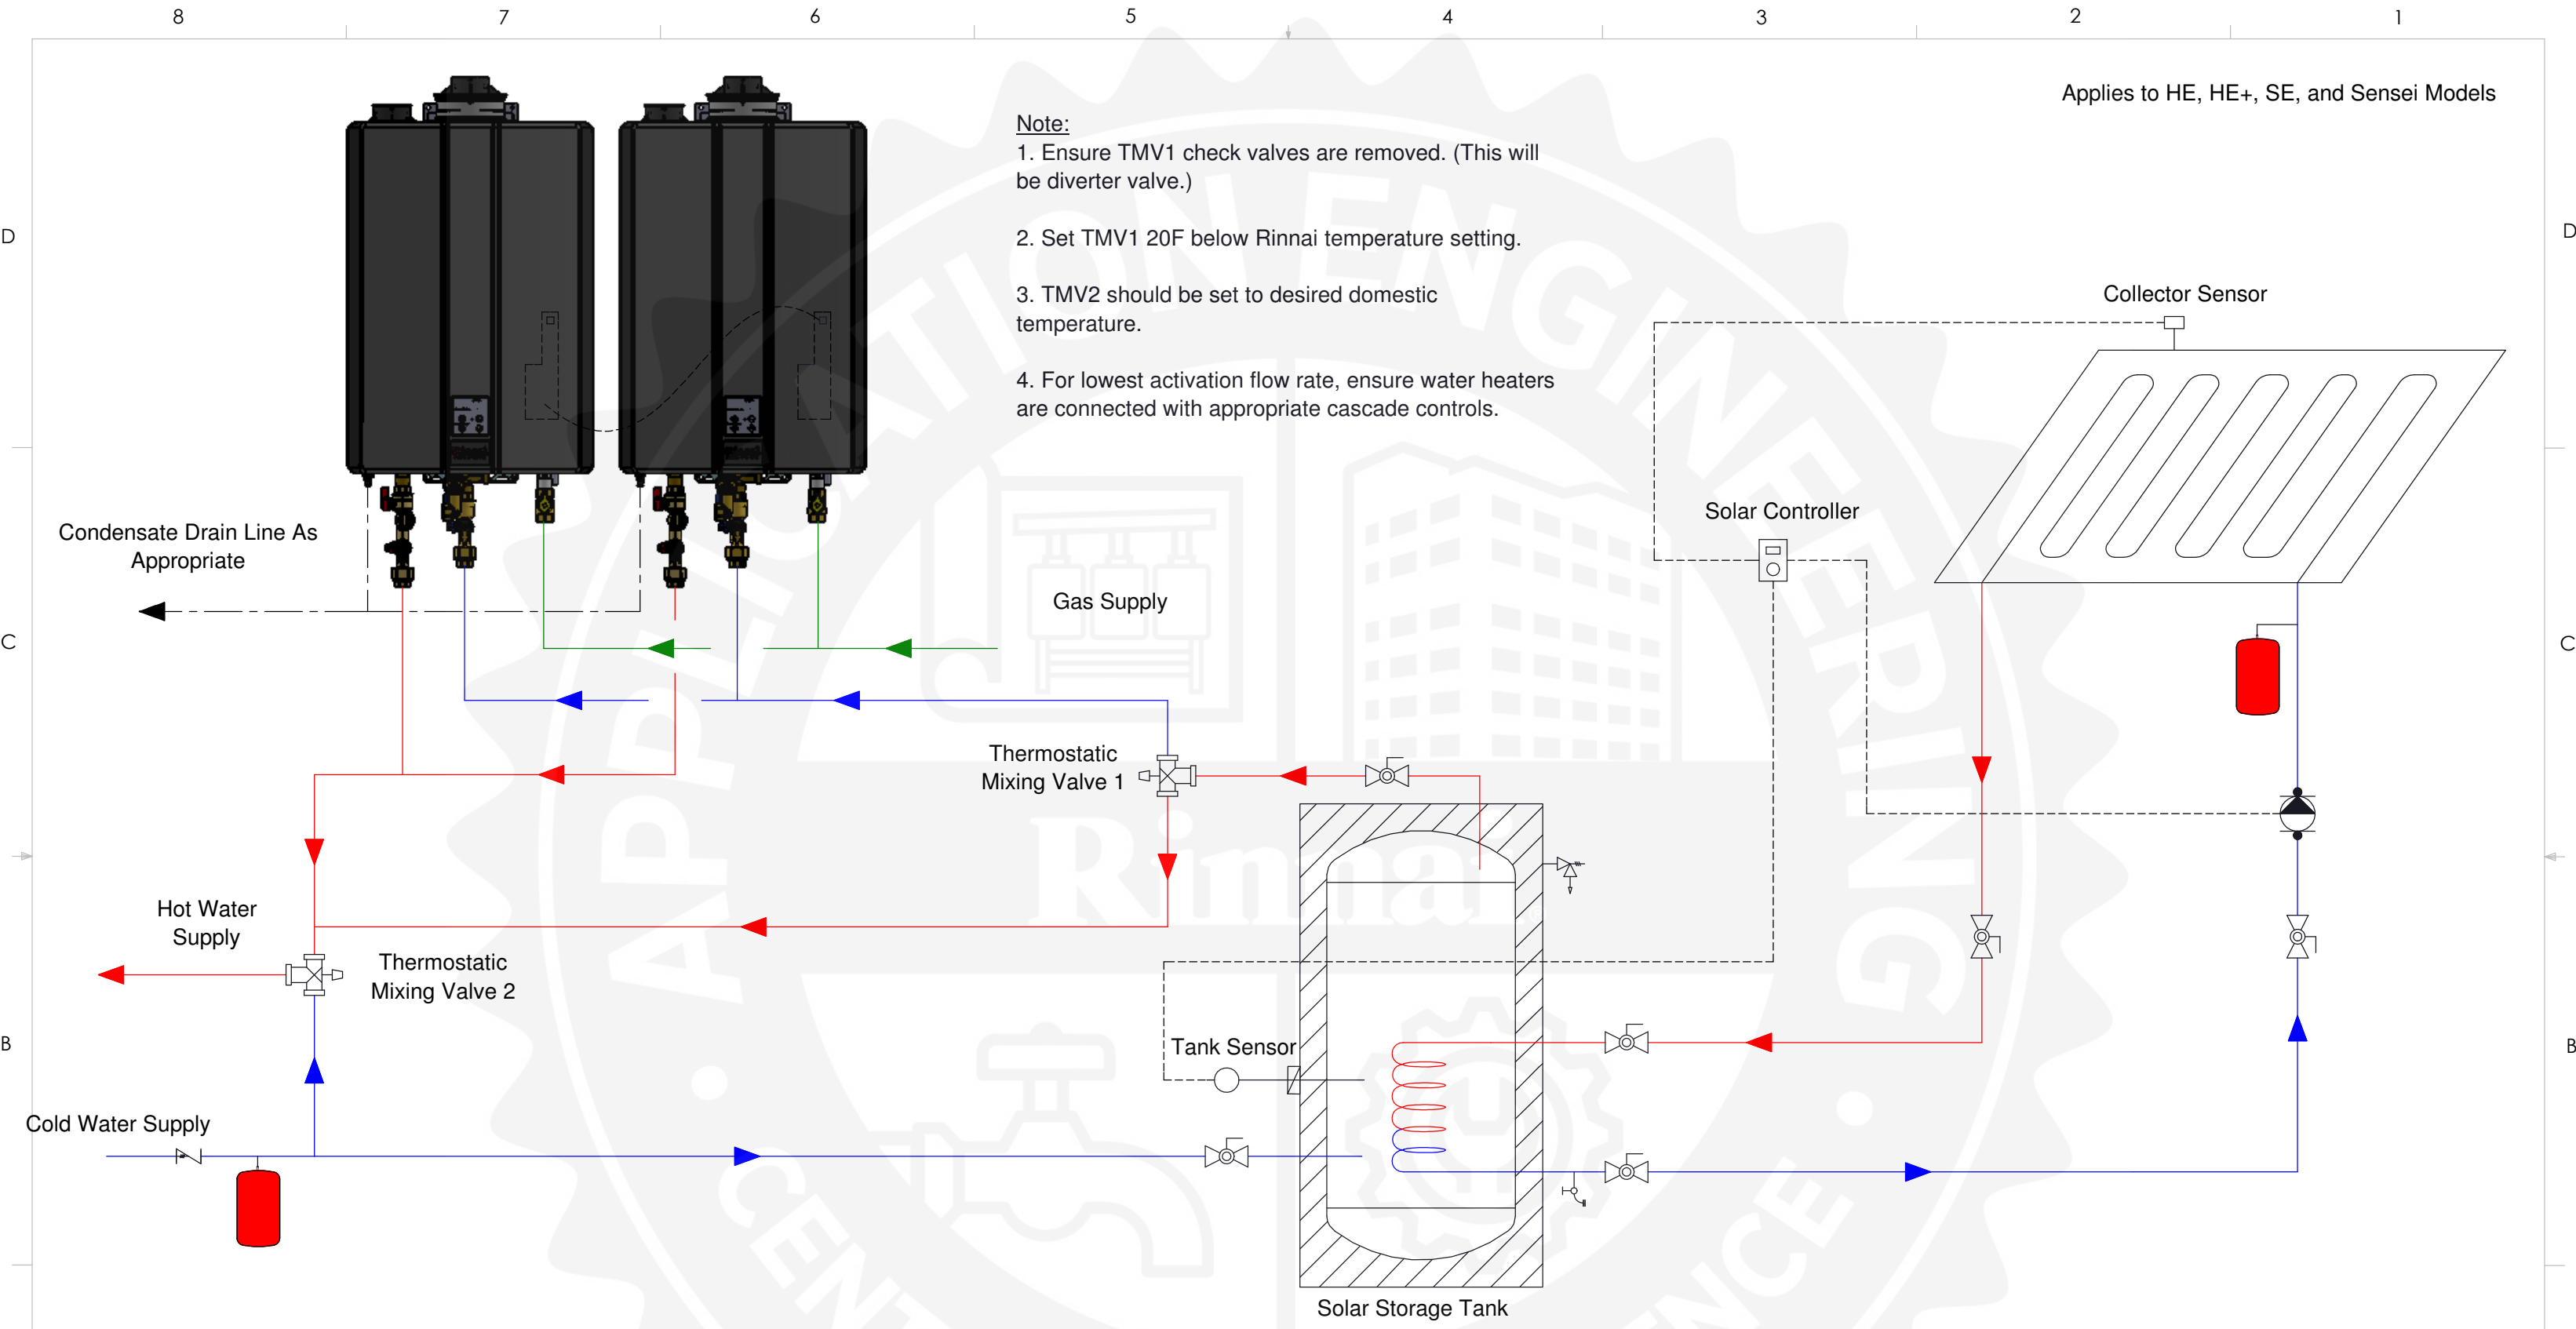

This is not an engineering drawing; it is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

RINNAI AMERICA CORPORATION
103 INTERNATIONAL DRIVE
PEACHTREE CITY, GA 30269
1-800-621-9419

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF RINNAI AMERICA. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF RINNAI AMERICA IS PROHIBITED.

UNLESS OTHERWISE SPECIFIED:

TOLERANCES:
Sheet Metal X.XX = ±0.030
X.XXX = ±0.010
Fraction = ±1/32
Angle = ±1.0°
MACHINED X.XXX = ±0.005
Angle = ±0.010°

INTERPRET GEOMETRIC TOLERANCING PER:

MATERIAL

FINISH

DO NOT SCALE DRAWING

	NAME	DATE
DRAWN	AB	11.16.2018
CHECKED	SH	12.15.2018
ENG APPR.	RS	12.15.2018

COMMENTS:



TITLE:
Systems Design Manual
Rinnai Tankless
Two Unit Solar Backup Option 2

SIZE	DWG. NO.	REV
B	WH2-S-2	

SCALE: NTS WEIGHT: SHEET 1 OF 1