




Technical Bulletin 113-Additional PVC/CPVC Termination Configuration

The purpose of this bulletin is to communicate the configuration pictured below as being an approved termination option for Rinnai condensing tankless water heaters utilizing dual pipe venting. For information regarding approved venting materials, installation, and clearances reference the Installation and Operation Manual included with the tankless water heater.

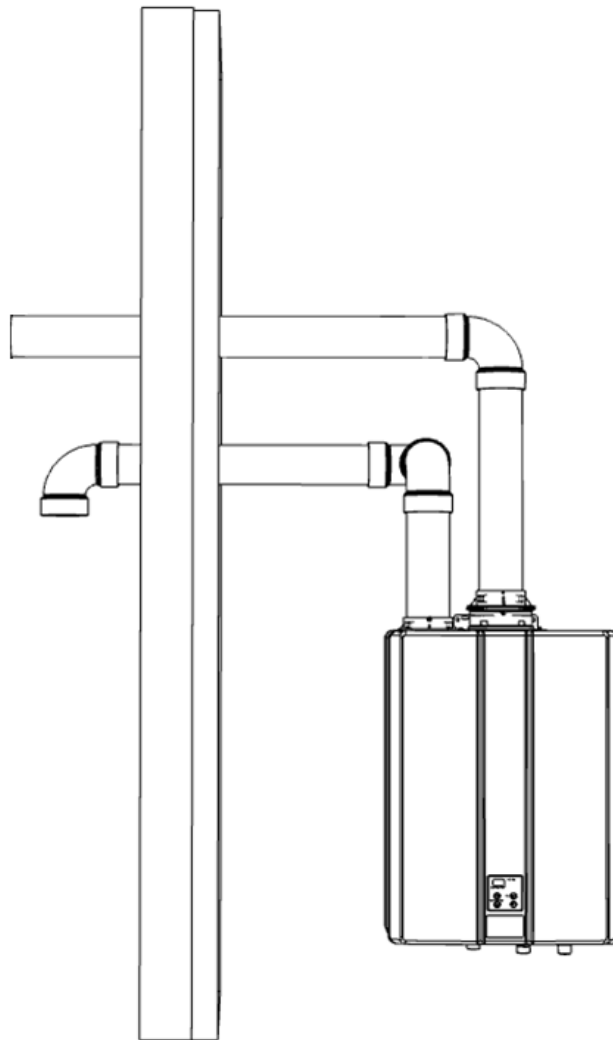

Rinnai America Corporation • 103 International Drive, Peachtree City, GA 30269

Toll-Free: 1-800-621-9419 • Phone: 678-829-1700 • www.rinnai.us

©2015 Rinnai America Corporation. Rinnai is continually updating and improving products; therefore, specifications are subject to change without prior notice. Local, state, provincial, federal and national fuel gas codes must be adhered to prior to and upon installation.