


Technical Bulletin 117-IPEX Concentric Termination

The purpose of this technical bulletin is to clarify the appropriate use of the IPEX concentric vent termination when venting with a two pipe pvc system. As stated in the installation and operation manual, the approved concentric system is the **IPEX System 636 Concentric Vent Termination Kit**. When terminating concentrically with a two pipe pvc system, you **MUST** use this system only. This termination has been specifically designed to separate combustion air from exhaust. You **MUST NOT** bring the exhaust and combustion air into a single PVC pipe using a wye.

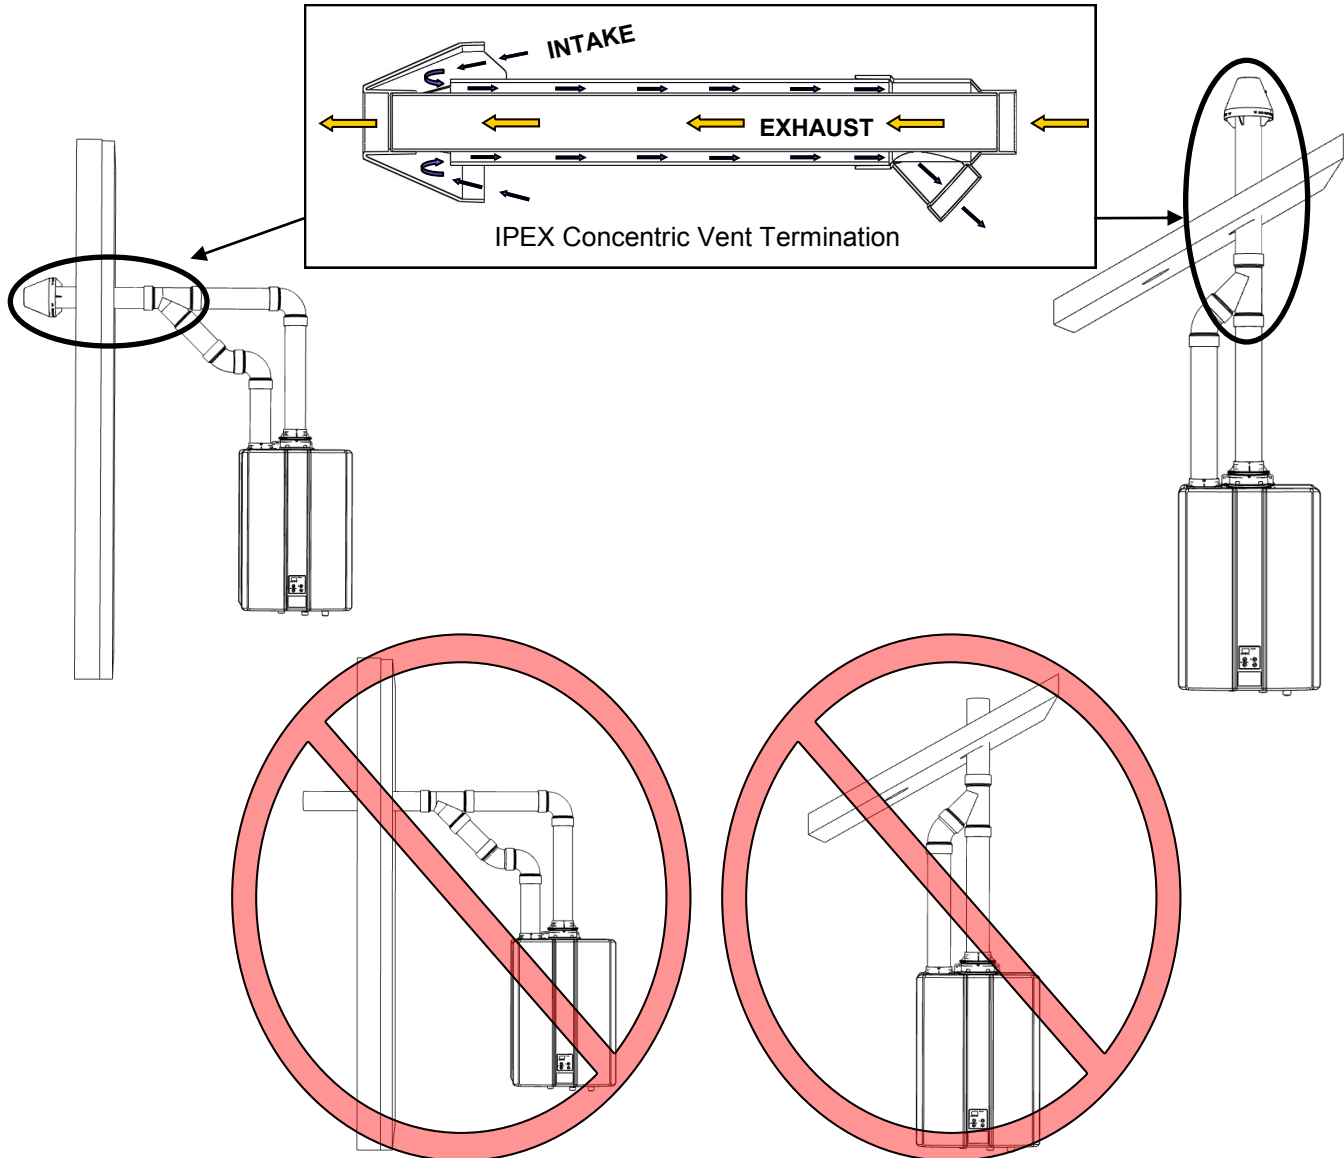

WARNING Improper installation of vent system and components, or failure to follow all installation instructions, can result in property damage, personal injury, or death.

Rinnai America Corporation • 103 International Drive, Peachtree City, GA 30269
Toll-Free: 1-800-621-9419 • Phone: 678-829-1700 • www.rinnai.us
©2015 Rinnai America Corporation. Rinnai is continually updating and improving products; therefore, specifications are subject to change without prior notice. Local, state, provincial, federal and national fuel gas codes must be adhered to prior to and upon installation.