



Cheat Sheet for 24Volt Wall Thermostats

STEP 1

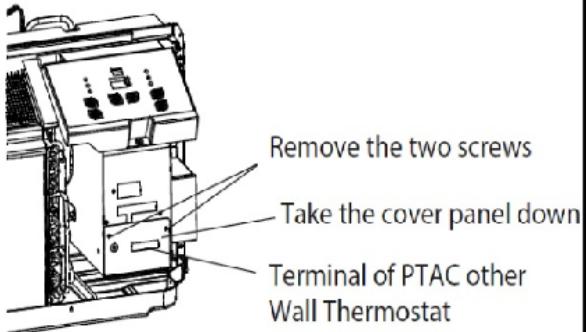


Terminal of PTAC other Wall Thermostat (MODE A)

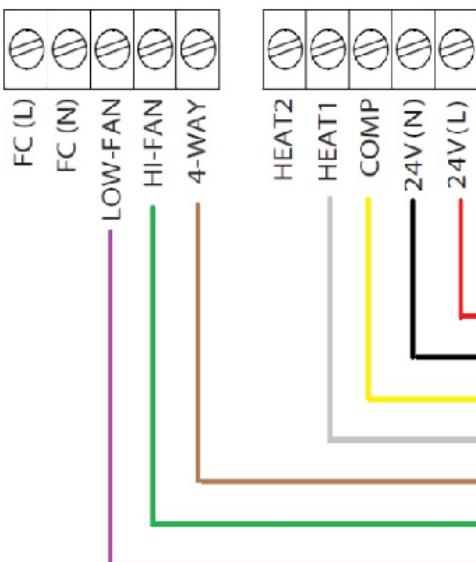


DIP SWITCHES CONFIGURATIONS

See Table 1 and Fig. 4 for Dip Switches configurations and functions of each dip switch position.

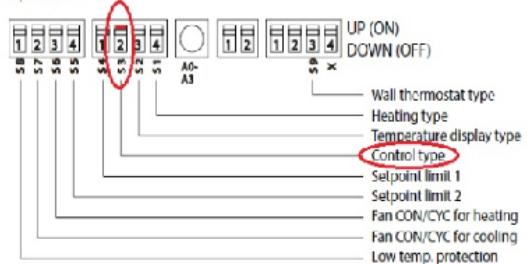

S3 must be on for wall thermostat control. Cycle the PTAC unit power off and on after making the change, for the selection to take effect.

Generic 24V Thermostat or Wireless Thermostat module

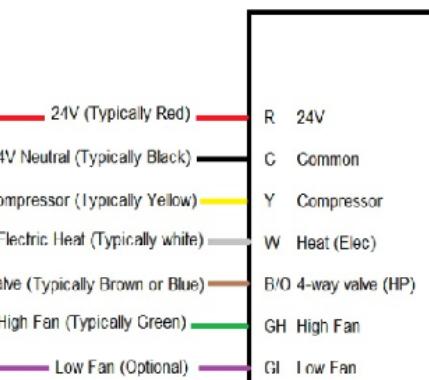

The S3 dip switch must be turned on and the S9 dip switch must be turned off. Also, please note that some wired controllers need to be programmed for switching the 4-way valve internally. Please read the wired thermostat directions to verify if this is required on you t-stat.

