


**Z415BZ**

BODY ASSEMBLY W/ "TYPE BZ" LEVELING STRAINER

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

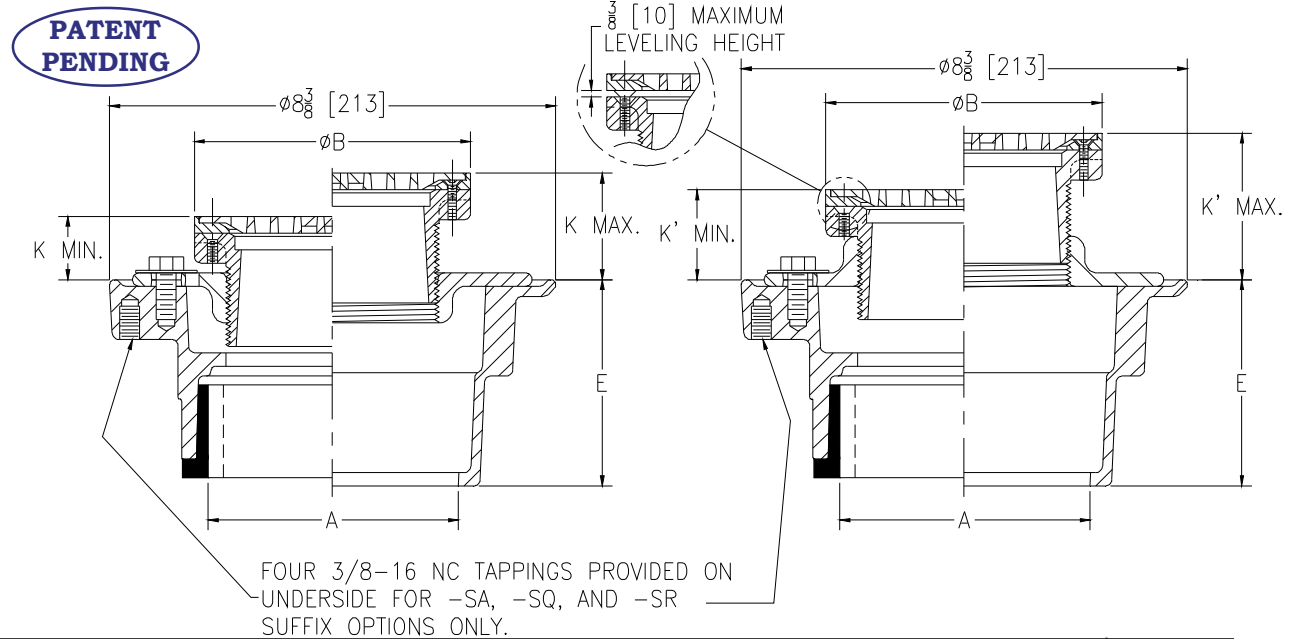

Dimensions In Inches						Approx. Wt. Lbs. [kg]	Strainer Open Area Sq. In. [cm²]
A Pipe Size	B Dia.	K		K'			
		Min.	Max.	Min.	Max.		
2-3 [51-76]	5-3/16 [132]	1-1/16 [27]	2-1/16 [52]	1-9/16 [40]	2-13/16 [71]	11 [5]	6-1/4 [40]
2-3-4 [51-76-102]	6-1/4 [159]	1-3/8 [35]	2-7/32 [56]	1-3/4 [44]	2-15/16 [75]	13 [6]	9 [58]

ENGINEERING SPECIFICATION: ZURNZN415BZ

Floor and shower drain, Dura-Coated cast iron body with bottom outlet, combination invertible membrane clamp and adjustable collar with seepage slots and "TYPE BZ" polished nickel bronze, light-duty, leveling strainer.

OPTIONS (Check/specify appropriate options)**PIPE SIZE**

2-3-4 [51-76-102]
2-3-4 [51-76-102]
2 [51]
3 [76]
4 [102]
2-3-4 [51-76-102]
2-3-4 [51-76-102]

(Specify size/type) OUTLET

_____ IC Inside Caulk
_____ IG Inside Gasket
_____ IP Threaded
_____ IP Threaded
_____ IP Threaded
_____ NH No-Hub
_____ NL Neo-Loc

'E' BODY HT. DIM.

3-7/8 [98]
3-7/8 [98]
2-3/8 [60]
2-5/8 [67]
2-7/8 [73]
3-7/8 [98]
3-3/4 [95]

PREFIXES

_____ ZB D.C.C.I. Body Assembly w/ Polished Bronze Top
_____ ZN D.C.C.I. Body Assembly w/ Polished Nickel Bronze Top*

SUFFIXES

_____ -AA All Acid Resisting Epoxy
_____ -AR Acid Resisting Epoxy Coated Cast Iron
_____ -CP Chrome-Plated Bronze Top
_____ -DP Decorative Polished Top
_____ -G Galvanized Cast Iron
_____ -OF Oval Funnel (Z329-7) (6 [152] Strainer Only)
_____ -P Trap Primer Connection (Specify 1/2 [13] or 3/4 [19])
_____ -PC Protective Cover
_____ -SA Stabilizer Assembly (See Z1035)
_____ -SQ Stabilizer Q-Deck (See Z1035-Q)
_____ -SR Stabilizer Ring

_____ -TC Neo-Loc Test Cap Gasket (2-4 [51-102] NL Outlet Only)
_____ -U 1-3 [25-76] High Extension Adapter
_____ -V Backwater Valve
_____ -VP Vandal-Proof Secured Top
_____ -Y Sediment Bucket
_____ -4 4 [102] Diameter Funnel (Z328)
_____ -90 90° Threaded Side Outlet Body Assembly (2 [51], 3 [76] Only)

**** For Installation Instructions, See Form #FD86.**

* Regularly furnished unless otherwise specified.

Zurn Industries, LLC | Specification Drainage Operation

1801 Pittsburgh Avenue, Erie, PA U.S.A. 16502 · Ph. 855-663-9876, Fax 814-454-7929

In Canada | **Zurn Industries Limited**

3544 Nashua Drive, Mississauga, Ontario L4V 1L2 · Ph. 905-405-8272, Fax 905-405-1292

www.zurn.com

Rev. H

Date: 3/13/14

C.N. No. 130698

Prod. | Dwg. No. Z415BZ