



**GE APPLIANCES**

## Single Zone

### Ductless Split Heat Pumps



**1G09CB2BEA / GS09WB2BEA**  
**1G12CB2BEA / GS12WB2BEA**  
**1G18CB2BEA / GS18WB2BEA**  
**1G24CB2BEA / GS24WB2BEA**



**GE APPLIANCES**  
*a Haier company*

**AIR&WATER**  
SOLUTIONS



## TABLE OF CONTENTS

|                                                     |           |
|-----------------------------------------------------|-----------|
| <b>1. SPECIFICATIONS.....</b>                       | <b>3</b>  |
| <b>2. SYSTEM.....</b>                               | <b>4</b>  |
| 2.1 General.....                                    | 4         |
| 2.2 Installation Requirements .....                 | 4         |
| 2.3 Electrical Requirements.....                    | 4         |
| 2.4 Refrigerant System Diagrams .....               | 5         |
| <b>3. OUTDOOR UNITS .....</b>                       | <b>6</b>  |
| 3.1 Dimensions.....                                 | 6         |
| 3.2 General.....                                    | 7         |
| 3.3 Installation .....                              | 7         |
| 3.4 Components.....                                 | 8         |
| 3.5 Wiring Diagrams .....                           | 9         |
| <b>4. HIGHWALL INDOOR UNITS.....</b>                | <b>10</b> |
| 4.1 Dimensions.....                                 | 10        |
| 4.2 Center of Gravity.....                          | 11        |
| 4.3 General.....                                    | 12        |
| 4.4 Installation .....                              | 12        |
| 4.5 Electrical Requirements.....                    | 13        |
| 4.6 Components.....                                 | 13        |
| 4.7 Wiring Diagrams .....                           | 14        |
| 4.8 Air Velocity and Temperature Distribution ..... | 15        |
| <b>5. CONTROLS AND ACCESSORIES.....</b>             | <b>18</b> |
| 5.1 Outdoor Unit Accessories .....                  | 18        |
| 5.2 Indoor Unit Accessories.....                    | 18        |
| 5.3 Controllers.....                                | 19        |
| 5.4 Indoor Unit Accessory Compatibility Table ..... | 20        |

### Revision History

**11-21-25:** Edition release.

**02-18-26:** Low ambient reference removed from 5.1.1 (Wind Baffles & Top Covers)

# 1. SPECIFICATIONS

## NOTE

Our continued commitment to quality products may mean a change in specifications without notice.  
Visit [GEAppliancesAirandWater.com](http://GEAppliancesAirandWater.com) to access current specification tables online.



| Outdoor Unit      |                                                           | 1G09CB2BEA                     | 1G12CB2BEA                     | 1G18CB2BEA                     | 1G24CB2BEA                     |
|-------------------|-----------------------------------------------------------|--------------------------------|--------------------------------|--------------------------------|--------------------------------|
| Indoor Unit       |                                                           | GS09WB2BEA                     | GS12WB2BEA                     | GS18WB2BEA                     | GS24WB2BEA                     |
| Cooling           | Rated Capacity Btu/hr                                     | 9,000                          | 11,800                         | 17,000                         | 24,000                         |
|                   | Capacity Range Btu/hr                                     | 3,400-10,000                   | 3,400-12,000                   | 6,000-17,500                   | 6,500-25,000                   |
|                   | SEER2                                                     | 23                             | 21                             | 20                             | 18                             |
|                   | EER2                                                      | 12                             | 12                             | 12                             | 12                             |
|                   | Moisture Removal Pt./hr                                   | 2.6                            | 2.7                            | 3.6                            | 4.9                            |
| Heating           | Rated Heating Capacity 47°F Btu/hr                        | 10,000                         | 13,000                         | 19,000                         | 24,000                         |
|                   | Heating Capacity Range Btu/hr                             | 3,400-11,000                   | 3,400-13,500                   | 6,000-21,000                   | 6,500-26,000                   |
|                   | HSPF2 (IV)                                                | 9.5                            | 9.5                            | 9.5                            | 9.5                            |
|                   | Rated Heating Capacity 5°F Btu/hr                         | 8,000                          | 10,400                         | 15,200                         | 19,200                         |
|                   | Heating Capacity at 5°F / Capacity at 47°F                | 80%                            | 80%                            | 80%                            | 80%                            |
|                   | COP 5°F                                                   | 1.8                            | 1.8                            | 1.8                            | 1.8                            |
| Operating Range   | Cooling (Without Wind Baffle or Top Cover)                | 23~115°F (-5~46°C)             | 23~115°F (-5~46°C)             | 23~115°F (-5~46°C)             | 23~115°F (-5~46°C)             |
|                   | Heating                                                   | -4~75°F (-20~24°C)             | -4~75°F (-20~24°C)             | -4~75°F (-20~24°C)             | -4~75°F (-20~24°C)             |
| Power Supply      | Voltage, Cycle, Phase (V/Hz/-)                            | 208-230/60/1                   | 208-230/60/1                   | 208-230/60/1                   | 208-230/60/1                   |
|                   | Maximum Fuse Size A                                       | 10                             | 10                             | 20                             | 30                             |
|                   | Minimum Circuit Amp A                                     | 9                              | 9                              | 15                             | 20                             |
| Outdoor Unit      | Compressor Type                                           | DC Inverter Rotary             | DC Inverter Rotary             | DC Inverter Rotary             | DC Inverter Rotary             |
|                   | Outdoor Noise Level dB                                    | 55                             | 55                             | 58                             | 61                             |
|                   | Dimension: Height in (mm)                                 | 21 3/4 (553)                   | 21 3/4 (553)                   | 25 1/4 (642)                   | 32 1/8 (815)                   |
|                   | Dimension: Width in (mm)                                  | 34 (863)                       | 34 (863)                       | 35 3/8 (898)                   | 40 3/8 (1024)                  |
|                   | Dimension: Depth in (mm)                                  | 11 (280)                       | 11 (280)                       | 12 (306)                       | 14 5/8 (370)                   |
|                   | Weight (Net/Ship) - lbs (kg)                              | 70.17/82.96 (31.8/37.6)        | 70.17/82.96 (31.8/37.6)        | 90.47/103.26 (41/46.8)         | 121.36/147.84 (55/67)          |
| Indoor Unit       | Basepan Heater                                            | No                             | No                             | No                             | No                             |
|                   | Fan Speed Stages                                          | 5 + Auto                       | 5 + Auto                       | 5 + Auto                       | 5 + Auto                       |
|                   | Airflow CFM: Cooling (Turbo/High/Med/Low/Quiet)           | 360/290/260/230/210            | 360/300/272/240/210            | 570/520/480/420/330            | 800/730/630/535/440            |
|                   | Airflow CFM: Heating (Turbo/High/Med/Low/Quiet)           | 350/290/250/220/200            | 350/290/260/230/200            | 570/520/450/380/310            | 800/730/630/535/440            |
|                   | Indoor Sound Level dB: Cooling (Turbo/High/Med/Low/Quiet) | 44/38/35/32/27                 | 44/39/36/33/27                 | 50/46/44/40/35                 | 54/50/47/44/38                 |
|                   | Indoor Sound Level dB: Heating (Turbo/High/Med/Low/Quiet) | 42/36/32/28/26                 | 42/36/32/29/26                 | 48/46/41/38/33                 | 54/50/47/44/38                 |
|                   | Auto Up-Down Louver                                       | Yes                            | Yes                            | Yes                            | Yes                            |
|                   | Auto Left-Right Louver                                    | No                             | No                             | No                             | No                             |
|                   | Drain Pipe Size O.D in                                    | 5/8                            | 5/8                            | 5/8                            | 5/8                            |
|                   | Dimension: Height in (mm)                                 | 11 7/8 (301)                   | 11 7/8 (301)                   | 12 7/8 (327)                   | 13 1/2 (343)                   |
|                   | Dimension: Width in (mm)                                  | 34 1/4 (870)                   | 34 1/4 (870)                   | 39 3/8 (999)                   | 44 1/2 (1129)                  |
|                   | Dimension: Depth in (mm)                                  | 7 3/4 (196)                    | 7 3/4 (196)                    | 8 3/4 (223)                    | 9 1/8 (232)                    |
|                   | Weight (Net/Ship) - lbs (kg)                              | 21.84/26.92 (9.9/12.2)         | 21.84/26.92 (9.9/12.2)         | 27.8/34.64 (12.6/15.7)         | 34.86/43.03 (15.8/19.5)        |
|                   | Factory-Installed Refrigerant Detection Sensor (RDS)      | No                             | No                             | No                             | No                             |
|                   | Refrigerant Detection Sensor (RDS)Compatible              | Yes (UALS01A, sold separately) | Yes (UALS01A, sold separately) | Yes (UALS01A, sold separately) | Yes (UALS01A, sold separately) |
| Refrigerant Lines | WiFi*                                                     | Built-in                       | Built-in                       | Built-in                       | Built-in                       |
|                   | Refrigerant                                               | R454B                          | R454B                          | R454B                          | R454B                          |
|                   | Connections                                               | Flare                          | Flare                          | Flare                          | Flare                          |
|                   | Liquid O.D. in                                            | 1/4                            | 1/4                            | 1/4                            | 1/4                            |
|                   | Suction O.D. in                                           | 3/8                            | 3/8                            | 1/2                            | 1/2                            |
|                   | Factory Charge Oz                                         | 36.5                           | 36.5                           | 45.9                           | 67.0                           |
|                   | Maximum Line Length Ft / m                                | 66/20                          | 66/20                          | 83/25                          | 165/50                         |
|                   | Maximum Height Ft / m                                     | 33/10                          | 33/10                          | 50/15                          | 100/30                         |

\*WiFi includes SmartHQ™ Home and SmartHQ™ Service compatibility.

## 2.1 General

### (2.1.1) Description

- A. The single heat pump air conditioner shall be a variable capacity, mini-split type system comprised of a single outdoor and a single wall-mounted indoor unit.

### (2.1.2) Toxicity

- A. The heat pump system shall participate in RoHS compliance and listed in the directory.

## 2.2 Installation Requirements

### (2.2.1) Lineset

- A. The connecting refrigerant lines between the indoor and outdoor units are to be supplied by the installer.  
 B. The tubing must be annealed ACR-type copper, meeting ASTM B280 standards.  
 C. The connecting tubing between the outdoor and indoor units shall be continuous in all possible situations.  
 D. The tubing ends must be reamed inside and out, and must be flared using a 45° flaring tool approved for R454B.  
 E. Connections to the indoor and outdoor units shall be made with flare nuts that are supplied with the individual units.  
 F. The flare nuts must be attached to indoor and outdoor units using a torque wrench and back-up wrench.

| Pipe Size | Torque            | A (inch)    | Flare Shape |
|-----------|-------------------|-------------|-------------|
| 1/4       | 12 lb/ft 16.3 Nm  | 0.327-0.343 |             |
| 3/8       | 27 lb/ft 36.6 Nm  | 0.472-0.488 |             |
| 1/2       | 40 lb/ft 54.2 Nm  | 0.488-0.654 |             |
| 5/8       | 50 lb/ft 67.8 Nm  | 0.732-0.748 |             |
| 3/4       | 80 lb/ft 108.5 Nm | 0.902-0.917 |             |

- G. Each tube must be insulated with a minimum of 1/2 inch (12.7mm) closed-foam insulation that is UV resistant and meets ASTM Standard E84 25/50 flame spread/smoke development.  
 H. The lineset between the indoor and outdoor must not exceed the listed maximum length and maximum height difference. (See section 1. **Specifications**, outdoor units).

## 2.3 Electrical Requirements

### (2.3.1) Electrical Supply

- A. The operating electrical requirements shall be 208/230 volts AC, single-phase, 60 hertz. Voltage supplied to the outdoor unit must be between 187-253 volts.  
 B. Power supply must be installed in accordance to local building and electrical code.

### (2.3.2) Connecting Wire to Indoor

- C. Connecting cable between the indoor unit(s) must be made with 4 conductor - 14 AWG stranded copper wire.  
 D. Connecting wire must be continuous (without break) unless local code requires power disconnect next to indoor unit.


## 2.4 Refrigerant System Diagrams

1G09CB2BEA/GS09WB2BEA

1G12CB2BEA/GS12WB2BEA

1G18CB2BEA/GS18WB2BEA


1G24CB2BEA/GS24WB2BEA

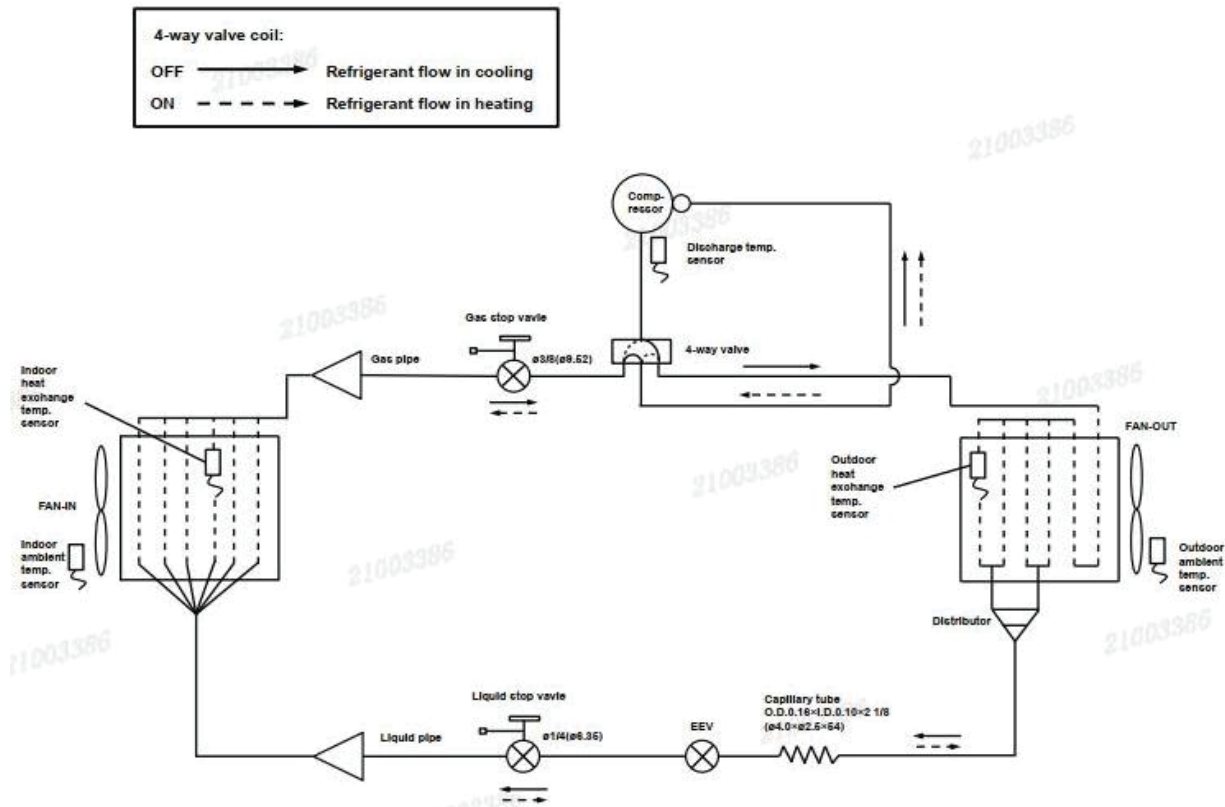


## 3. OUTDOOR UNITS

### 3.1 Dimensions


1G09CB2BEA  
1G12CB2BEA

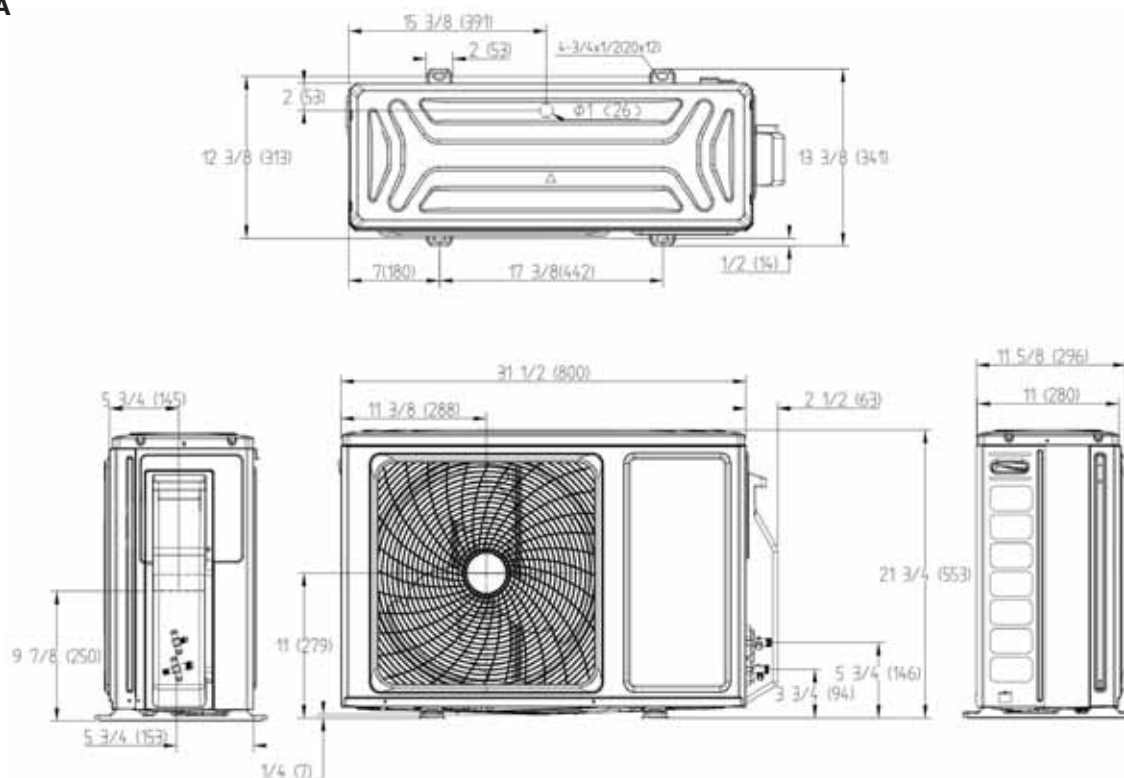

1G18CB2BEA

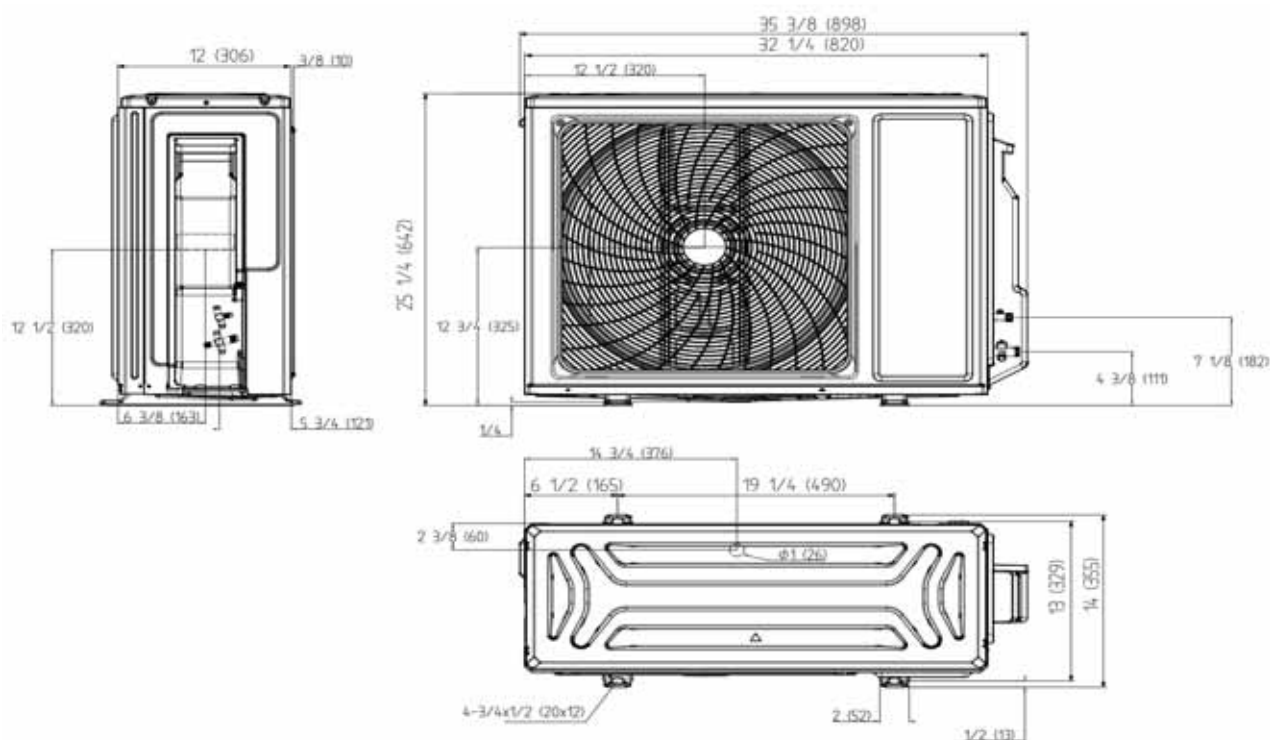

## 1G24CB2BEA

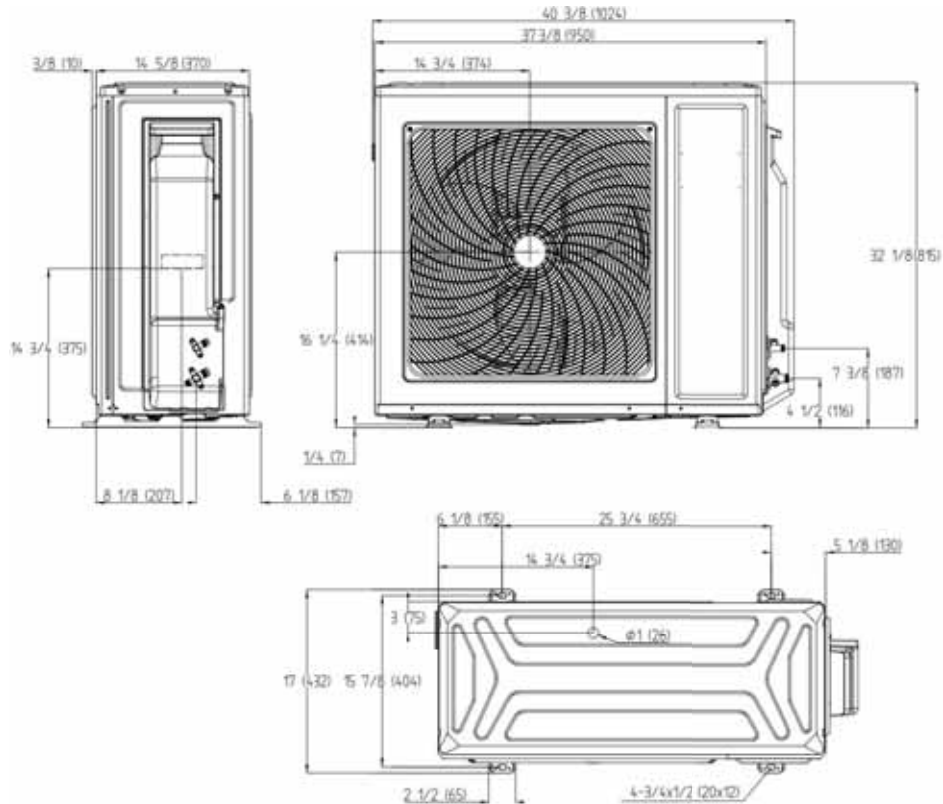

## 3.2 General

### (3.2.1) Outdoor Unit Description

- A. The outdoor unit shall be comprised of a condenser coil with all components and controls necessary to perform the rated operation.

### (3.2.2) Sound Pressure Rating

- A. Sound pressure rating as measured according to test standard JIS C 961:

| Model      | Sound Pressure Rating dB(A) | Microphone Location (ft) |
|------------|-----------------------------|--------------------------|
| 1G09CB2BEA | 55                          | 3.28                     |
| 1G12CB2BEA | 55                          | 3.28                     |
| 1G18CB2BEA | 58                          | 3.28                     |
| 1G24CB2BEA | 61                          | 3.28                     |

## 3.3 Installation

### (3.3.1) Condensate

- A. The installer must adhere to local building codes for managing condensate water produced by the outdoor unit.

### (3.3.2) Clearances

- A. The installer must follow the recommended clearances provided in the Installation Manual.

## 3.4 Components

### (3.4.1) Coil

- A. The outdoor coil shall be made with a blue colored hydrophilic coating on the aluminum fins and packed with internally grooved copper tubing, to increase the effective heat exchange surface area by 25%, resulting in higher efficiencies and shorter defrost cycles(approx. 29%).
- B. Coils shall be helium pressure tested at the factory within a range of 600 - 650 PSI.
- C. Outdoor unit shall be factory charged with R454B refrigerant for 25 feet of lineset.
- D. The coils have passed 1,000 hours salt spray test.

### (3.4.2) Fan Motor

- A. The outdoor fan motor shall be a brushless, variable speed DCV motor type.
- B. The fan motor shall be molded with heat-hardened resin.
- C. The fan motor shall have permanently lubricated SRC bearings.

### (3.4.3) Fan Blade

- A. The outdoor fan blade shall be a UL flame rated plastic-resin design.
- B. The fan blade shall be factory balanced in quiet performance and enhanced velocity.

### (3.4.4) Compressor

- A. The compressor shall be a DC rotary type and A-PAM inverter-driven for stable operation in lower and higher frequency.
- B. The compressor shall be variable speed, variable capacity.
- C. The compressor shall have an internal overload protection device.
- D. The compressor shall use RM68EH refrigerant oil for better anti-wear effectiveness, superior resistance to capillary tube blockage and no hydrolysis compared to POE oil.

### (3.4.5) 4WV

- A. The outdoor unit shall contain a four-way reversing valve (4WV) to change system mode from cool to heat.

### (3.4.6) EEV

- A. The refrigerant flow shall be regulated by an electronic expansion valve (EEV).
- B. The outdoor control shall monitor the refrigerant flow through the EEV using a pulse-operated coil.
- C. The EEV shall maintain the target of 10°F (5.5°C) of superheat.

### (3.4.7) Base Pan

- A. The base pan shall be constructed of commercial grade DC51/DC52 hot-dip galvanized steel with coating.

### (3.4.8) Copper Piping

- A. All internally connected copper tubing shall conform to ASTM B280 tubing tolerances.

### (3.4.9) Outdoor Enclosure Materials

- A. The outdoor cabinet shall be constructed of commercial grade DC51/DC52 hot-dip galvanized steel with coating.  
Screw Size:#4x1/4in Phillips Pan Head Zinc Plated Sheet Metal Screw.


### (3.4.10) Defrost

- A. The outdoor unit shall have a reverse-cycle (hot gas) defrost system to maximize heat pump operation and minimize energy consumption.

### (3.4.11) Accumulator

- A. The accumulator shall be connected to the compressor return line to prevent liquid refrigerant from entering the compressor during operation.


## 3.5 Wiring Diagrams

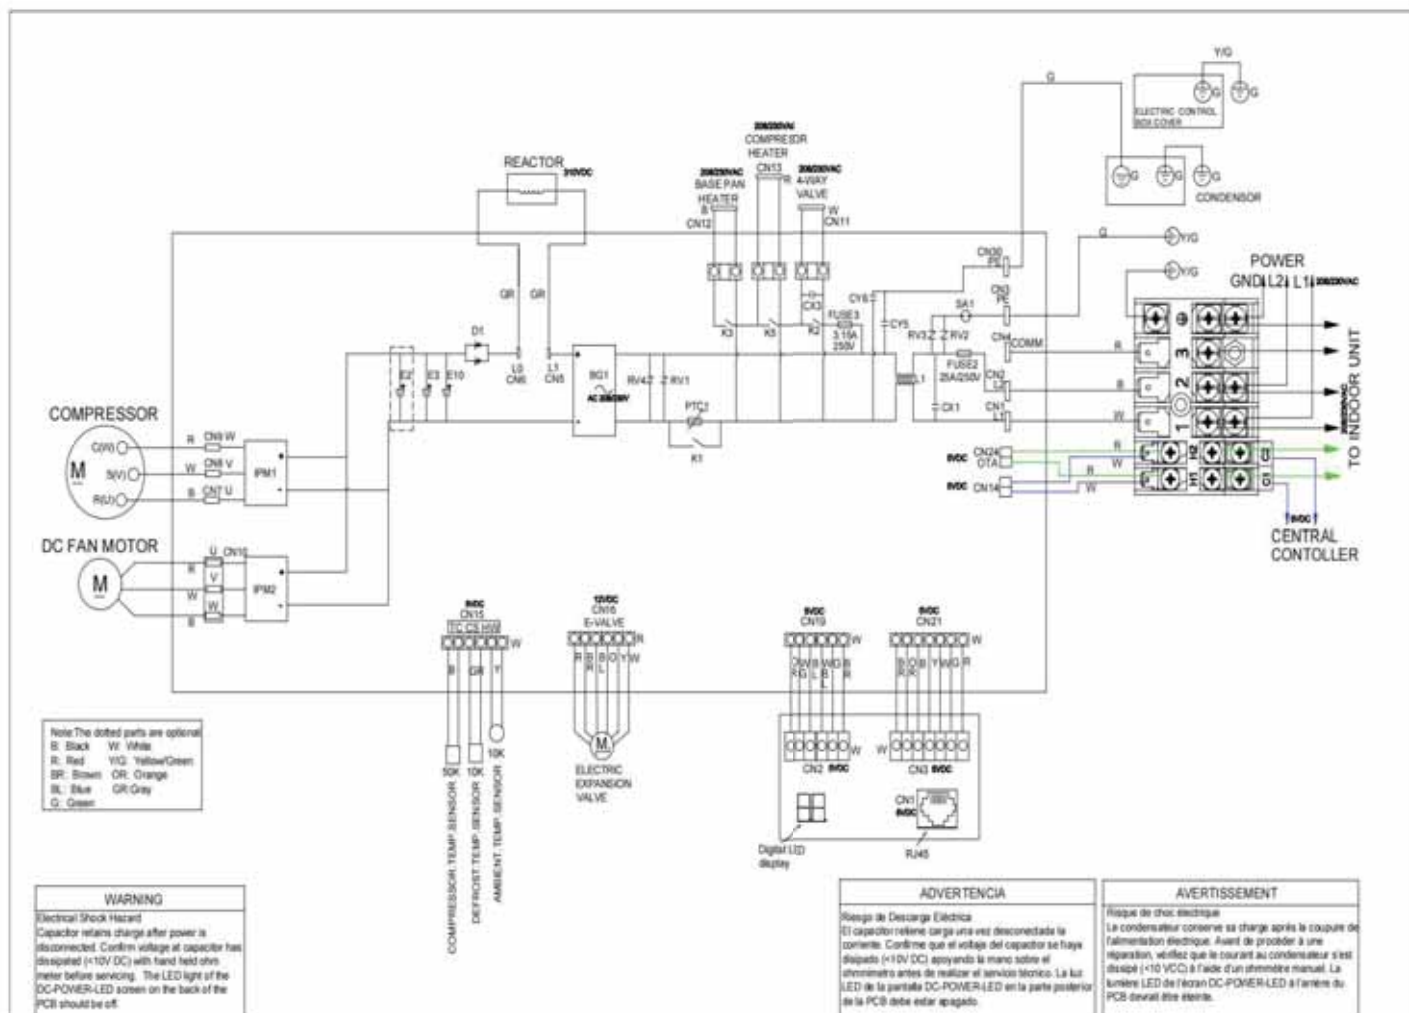


## 4. HIGHWALL INDOOR UNITS

### 4.1 Dimensions

GS09WB2BEA  
GS12WB2BEA

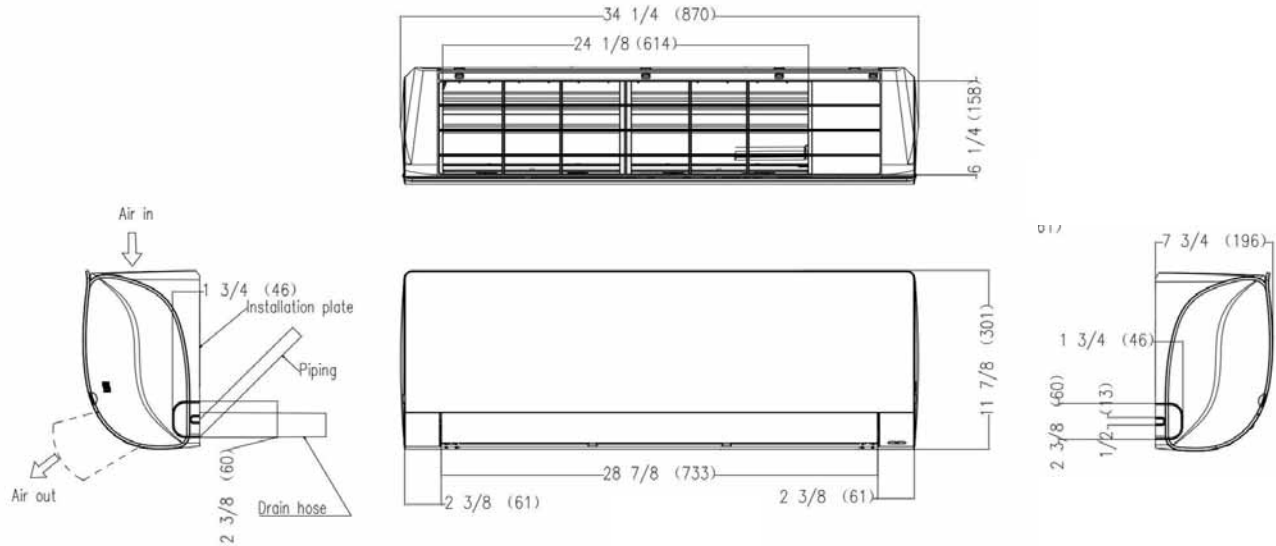


GS18WB2BEA

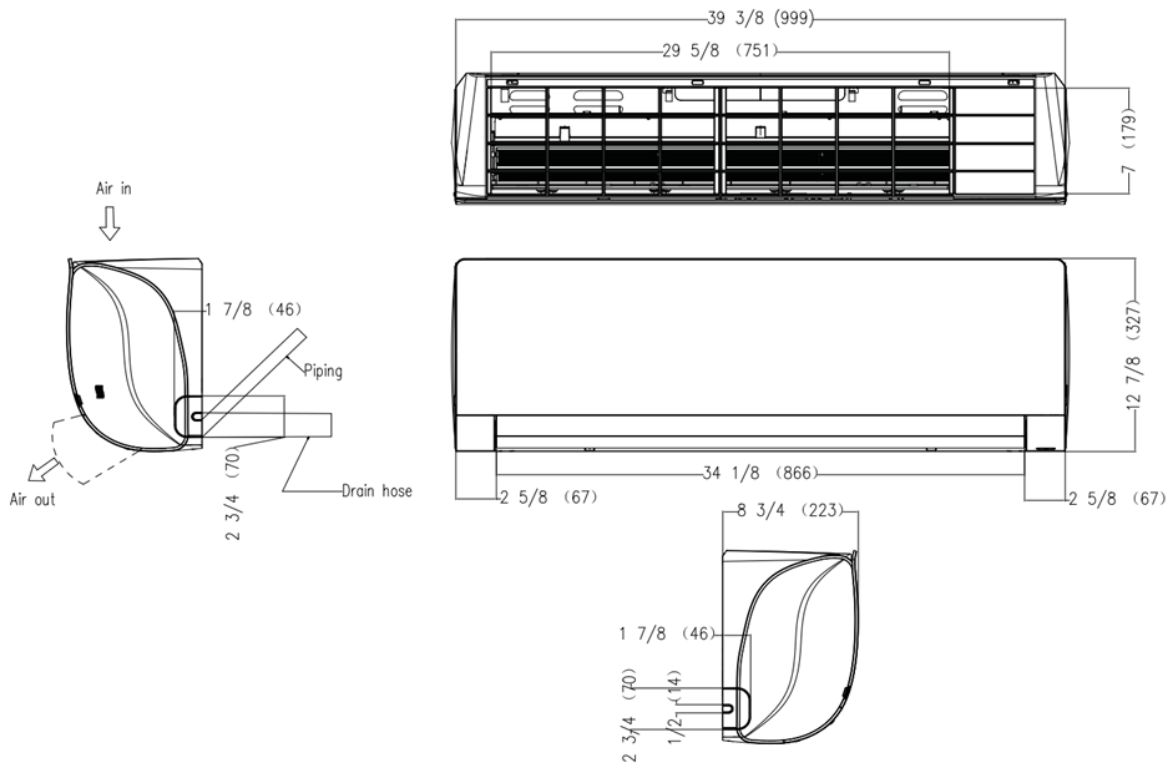


## 4. HIGHWALL INDOOR UNITS

### GS24WB2BEA

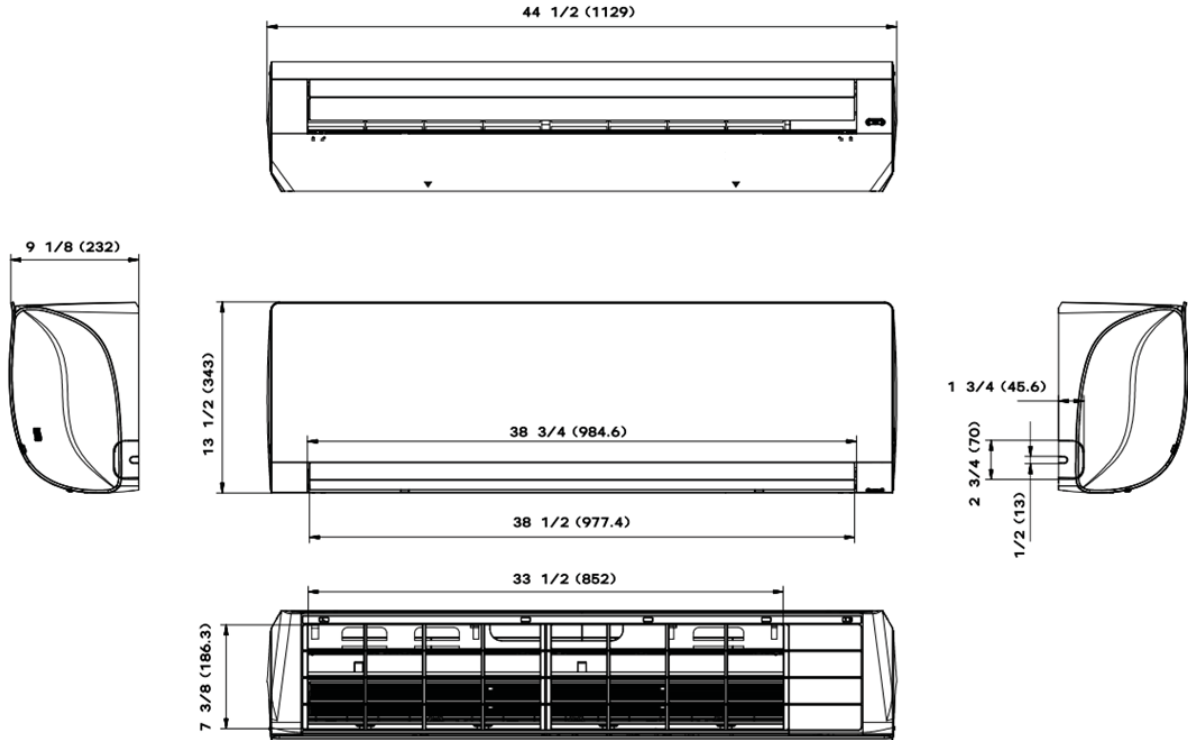


### 4.2 Center of Gravity

#### GS09WB2BEA GS12WB2BEA

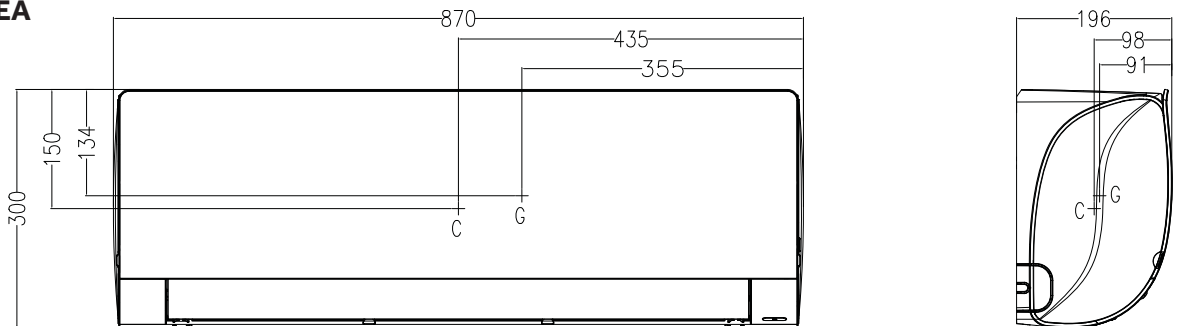


### GS15WB2BEA

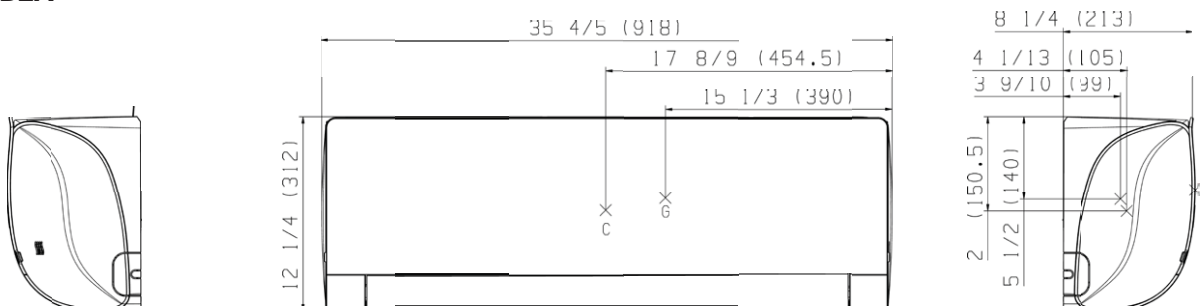

## 4. HIGHWALL INDOOR UNITS

### GS24WB2BEA

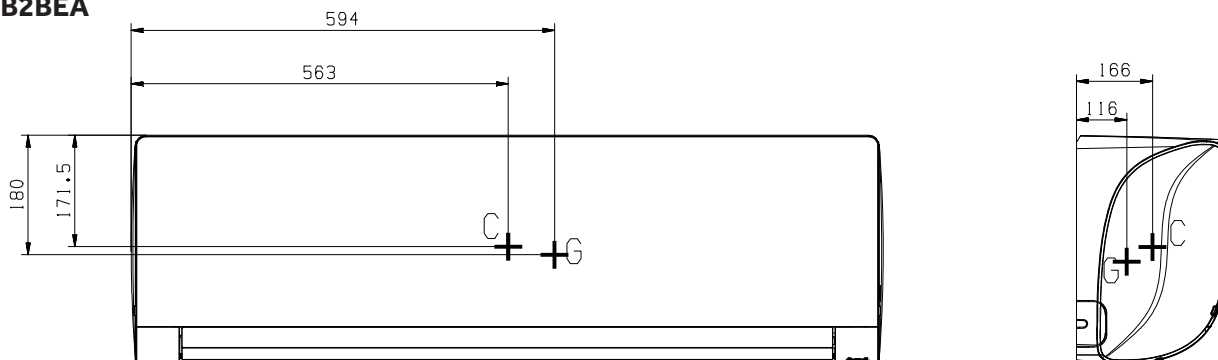

### 4.3 General

#### (4.3.1) Indoor Unit Description

- A. The wall mounted indoor section completes the system when connected to the matching outdoor unit and field-supplied piping and wiring.

#### (4.3.2) Sound Ratings

- A. Sound ratings as measured according to test standard JIS C 9612:

| Model      | Sound Pressure Level dB(A)<br>(Turbo/High/Med/Low/Quiet) | Sound Power Level dB(A)<br>(Turbo/High/Med/Low/Quiet) | Microphone Location |
|------------|----------------------------------------------------------|-------------------------------------------------------|---------------------|
| GS09WB2BEA | 44/38/35/32/27                                           | 52/46/43/40/35                                        |                     |
| GS12WB2BEA | 44/39/36/33/27                                           | 52/47/44/41/35                                        |                     |
| GS18WB2BEA | 50/46/44/40/35                                           | 58/54/52/48/43                                        |                     |
| GS24WB2BEA | 54/50/47/44/38                                           | 62/58/55/52/46                                        |                     |

### 4.4 Installation

#### (4.4.1) Condensate

- A. The wall mounted indoor shall be shipped with a insulated polyethylene condensate tubing (5/8"ID) attached from the factory.
- B. The wall mounted indoor unit shall ship with a 65ft (2m) corrugated drain tube that connects to the insulated drain tube.
- C. The wall mounted indoor unit shall be a gravity drain.

#### (4.4.2) Clearances

- A. The installer must follow the minimum clearances illustrated in the Installation Manual when installing the indoor unit.

#### (4.4.3) Mounting

- A. The wall mounted indoor unit shall ship with a galvanized metal wall bracket.
- B. The wall bracket shall have multiple anchor points to provide the installer with many options to firmly attach the wall mounted indoor unit the wall.
- C. The field-supplied mounting hardware must be adequate to support the indoor unit.

## 4. HIGHWALL INDOOR UNITS

### 4.5 Electrical Requirements

#### (4.5.1) Electrical Disconnect

- A. Connecting wire must be continuous (without break) unless local code requires a disconnect at the indoor unit.
- B. If a disconnect is required by local code, it must be a 3-pole, single-throw type.

| Model                                  | Fan Motor Power Output (W) |
|----------------------------------------|----------------------------|
| GS09WB2BEA<br>GS12WB2BEA<br>GS18WB2BEA | 40                         |
| GS24WB2BEA                             | 70                         |

### 4.6 Components

#### (4.6.1) Coil

- A. The indoor coil shall be made with a blue colored hydrophobic coating on the aluminum fins and packed with internal grooved copper tubing, to increase the effective heat exchange surface area by 25%.
- B. Copper tubing shall have inner micro-grooves to increase effective heat transfer capabilities.
- C. Coils shall be pressure tested at 600-650 PSI using helium leak detection.
- D. The coil shall be charged with dry nitrogen for shipping at 70-100 PSI.

#### (4.6.2) Fan Motor

- A. The fan motor shall be a sealed DC multiple-speed resin-packed motor
- B. The fan motor shall have permanently lubricated bearings.

#### (4.6.3) Fan Blade

- A. The fan blade shall be a corrosion-resistant cross-flow blower.
- B. The fan shall be designed with optimized diameter and surface area to deliver quiet and even air flow.

#### (4.6.4) Copper Piping

- A. The coil shall be connected to a length of insulated annealed copper.
- B. The ends of the tubing shall have male flare connections.

#### (4.6.5) Air Louvers

- A. The supply air shall be distributed by horizontal non-motorized and vertical motorized louvers.
- B. Air Louvers shall provide wide angle of operation for both horizontal (120°) and vertical (90° from top to down) airflow movement to provide room comfort for each corner.

#### (4.6.6) Display

- A. The wall mounted indoor unit shall have a 4.5 x 1.1-inch backlit temperature display capable of showing set or room temperatures.
- B. The display shall also have colored icons representing set mode.
- C. The display can be turned off from the wireless remote control.

#### (4.6.7) WiFi

- A. Wall mounted indoor units shall come equipped with WiFi capabilities.

#### (4.6.8) Filter

- A. The wall mounted indoor unit shall have removable air filters.
- B. The air filters shall be washable and reusable.

#### (4.6.9) Control

- A. The wall mounted indoor unit shall ship with the standard hand-held remote control.
- B. The wall mounted indoor unit shall be compatible with the simple wired controller and the programmable wired controller.

#### (4.6.10) Installation Clip


- A. The wall mounted indoor unit shall have a built-in clip that swings out and acts as a kick stand to allow for easier access to the rear of the unit during installation and repair.

# 4. HIGHWALL INDOOR UNITS

## 4.7 Wiring Diagrams

### INDOOR UNIT WIRING DIAGRAM



0011534809

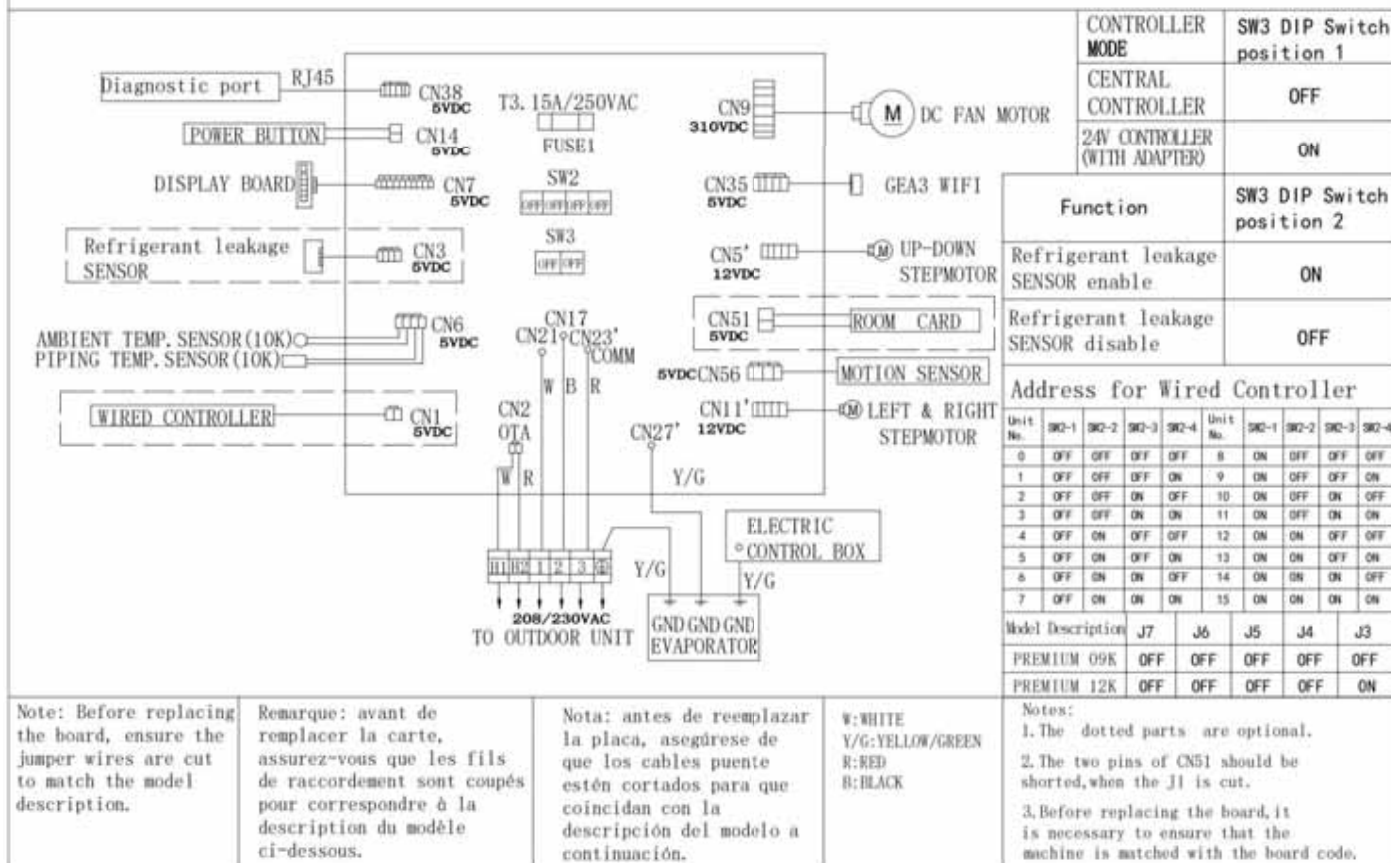



## 4.8 Air Velocity and Temperature Distribution

GS09WB2BEA  
GS12WB2BEA

### COOLING

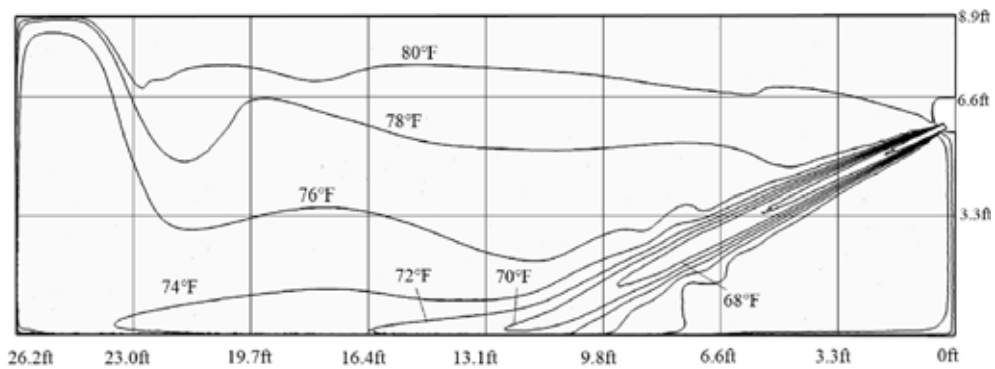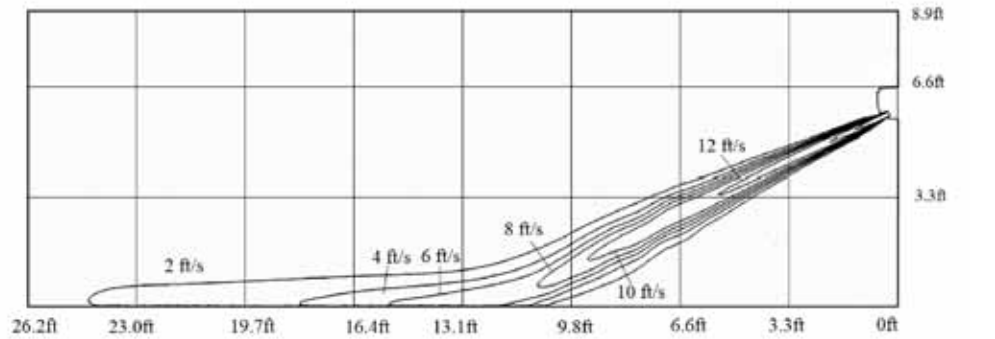



### HEATING

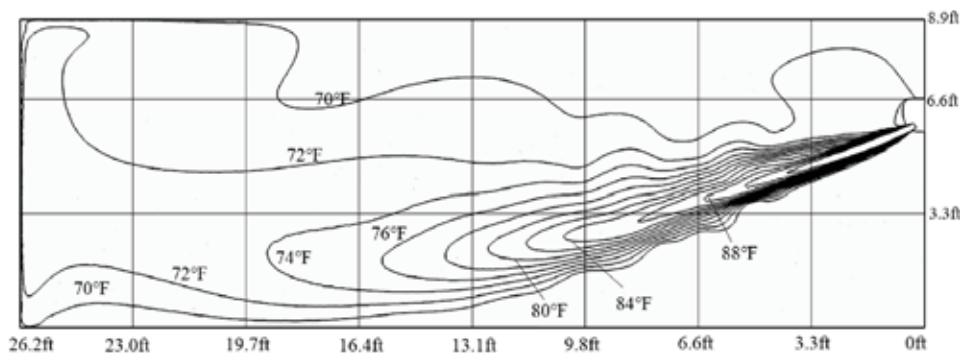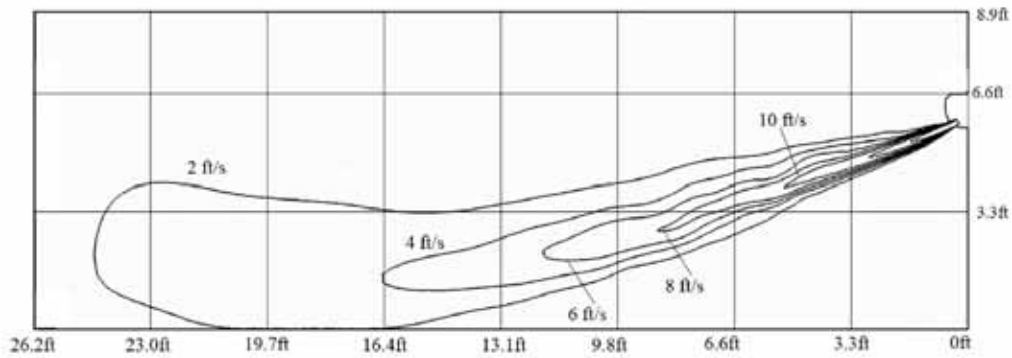



## 4. HIGHWALL INDOOR UNITS

GS18WB2BEA

### COOLING

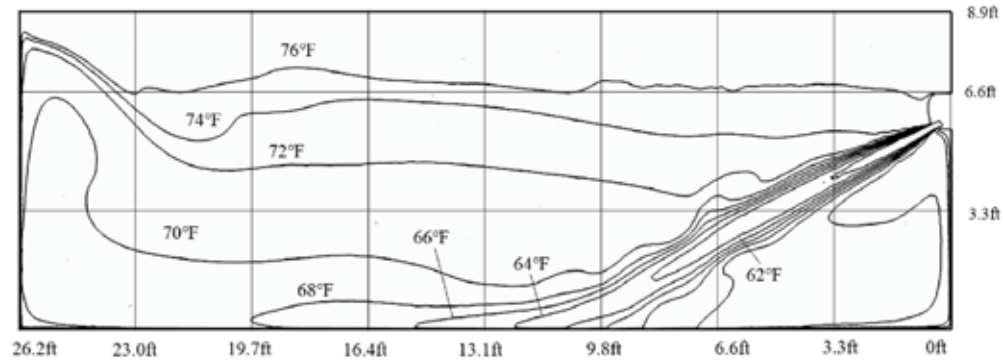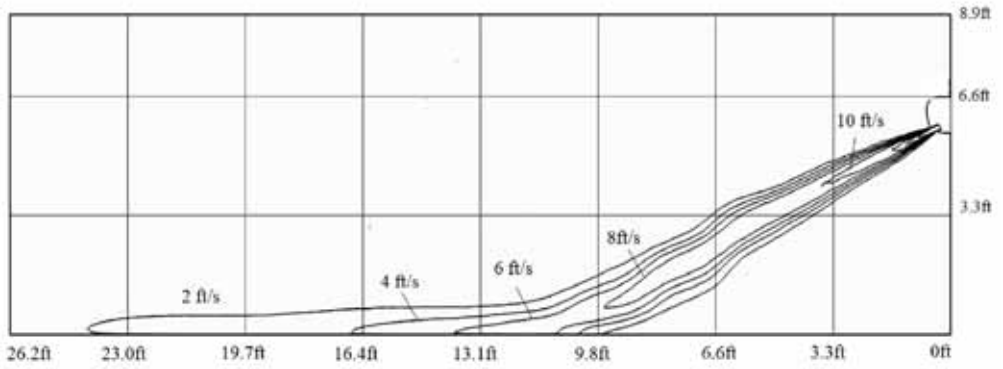


### HEATING

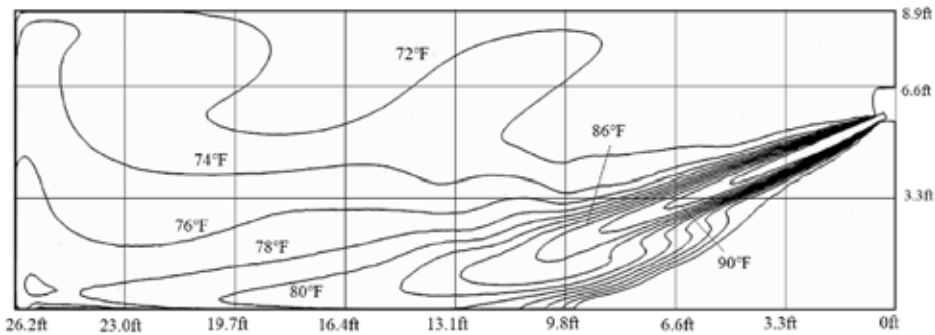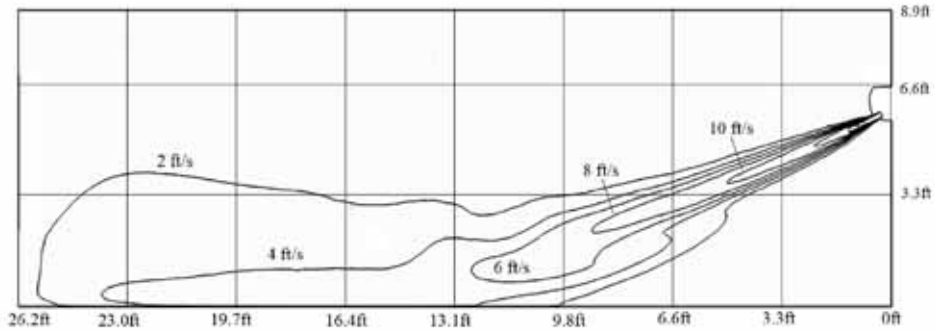


GS24WB2BEA

COOLING

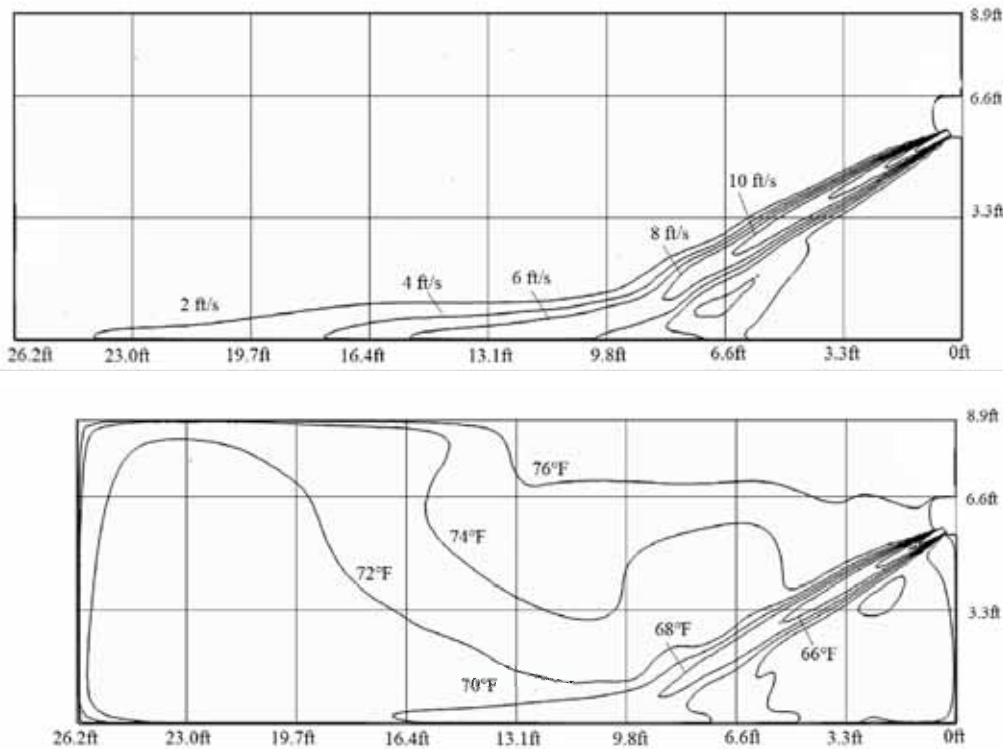

HEATING

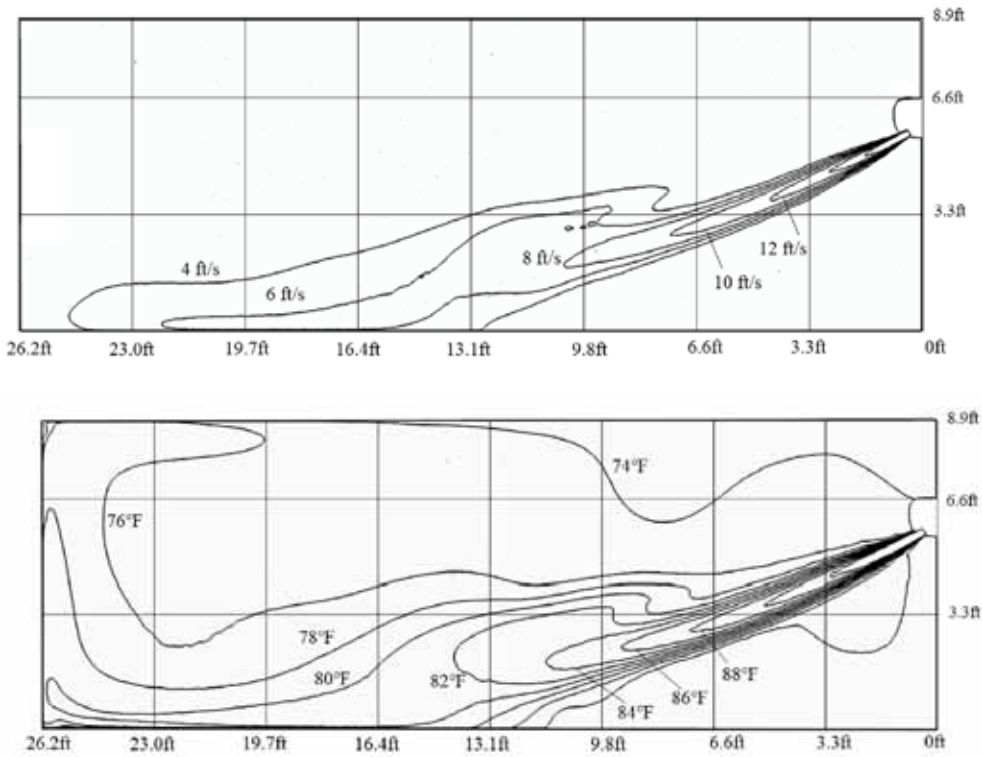


## 8. CONTROLS AND ACCESSORIES

### 5.1 Outdoor Unit Accessories

#### (5.1.1) Wind Baffles & Top Covers

| Operating Conditions                                    | Recommended Accessories |                       |                       |                      |
|---------------------------------------------------------|-------------------------|-----------------------|-----------------------|----------------------|
|                                                         | 1<br>Front Wind Baffle  | 2<br>Side Wind Baffle | 3<br>Back Wind Baffle | 4<br>Top Cover       |
| Low Ambient Heating below 5°F (-15°C)                   | -                       | Strongly Recommended  | Strongly Recommended  | Strongly Recommended |
| Unit installed on a flat roof or facing prevailing wind | Required                | -                     | -                     | -                    |

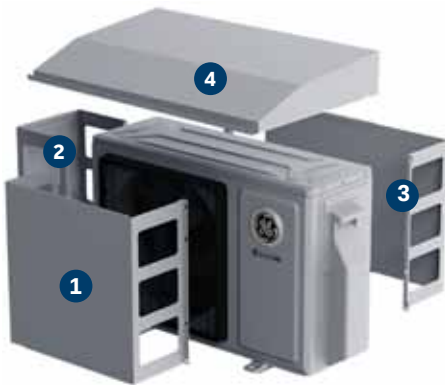

Fabricated from durable 20 gauge G90 galvanized steel and engineered to provide optimal performance when operating the outdoor unit in cold, harsh climates.

A front wind baffle is required for all climates when mounted on a flat roof or facing prevailing winds.

| Model      | Front or Back Wind Baffles<br>(If both a front and back wind baffle are needed, order two (2) of the required part) | Side Wind Baffles | Top Covers |
|------------|---------------------------------------------------------------------------------------------------------------------|-------------------|------------|
| GS09WB2BEA | UAWB15GA                                                                                                            | UASWB15GA         | UATC15GA   |
| GS12WB2BEA | UAWB15GA                                                                                                            | UASWB15GA         | UATC15GA   |
| GS18WB2BEA | UAWB15GA                                                                                                            | UASWB15GA         | UATC20GA   |
| GS24WB2BEA | UAWB30GA                                                                                                            | UASWB30GA         | UATC35GA   |

### 5.2 Indoor Unit Accessories

#### (5.2.1) UALS01A Refrigerant Detection Sensor (RDS)

Note: See room sizing requirements to determine if the Refrigerant Detection Sensor (RDS) is required and needs to be purchased separately for highwall and cassette indoor units. RDS is factory-installed on console and ducted units.



#### (5.2.5) WiFi

##### General

- A. Units to come complete with WiFi Built in.

##### Connection

- B. The WiFi adapter shall have an app that is compatible with both iOS and Android.
- C. The WiFi adapter shall be paired with existing 2.4GHz network.
- D. The WiFi adapter shall comply with Part 15 of the FCC rules..

##### Warranty

- A. The warranty shall cover all defects in workmanship or material for a period of 1 year. Haier will provide a new or refurbished controller, at its sole discretion.

##### Features

- A. The WiFi adapter shall be Google Home compatible.
- B. The WiFi adapter shall be Amazon Alexa compatible.
- C. The homeowner shall have the ability to install and configure the WiFi adapter.

## 5.3 Controllers

Controllers from Haier allow you to take command of your environment. With convenient user-friendly button layouts and clear digital displays, the system can be easily set to meet and maintain comfort levels.

### (5.3.1) Remote Controllers

#### General

- A. Standard Remote Control shall be compatible with wall mounted indoor units.
- B. Standard Remote Control shall come packaged with wall mounted indoor units.

#### Connection

- A. Standard remote control shall be infrared.

#### Compatibility

- A. The wireless control shall be compatible with all wall mounted, floor console and cassette indoor models.

#### Warranty

- A. The warranty shall also cover all defects in workmanship or material for the unit accessory for a period of 1 year. Haier will provide a new or refurbished controller at its sole discretion.

#### Features

- A. The Standard Remote Control shall have a power button, individual mode buttons (heat, cool, dehumidify), temperature +/-, fan speed, vertical and horizontal louver adjust.
- B. The Standard Remote Control shall be capable of setting a precise temperature of  $\pm 1^{\circ}\text{F}$  ( $\pm 0.5^{\circ}\text{C}$ ).
- C. The Standard Remote Control shall have a backlight.
- D. The Standard Remote Control shall have vertical and horizontal louver control.
- E. The Standard Remote Control shall have a child lock function.
- F. The Standard Remote Control shall have the ability to turn on/off the indoor unit display.
- G. The Standard Remote Control shall have Fahrenheit and Celsius temperature functions.



### (5.3.2) Wired Controller

#### General

- A. The wired controller shall be a wall-mounted control that operates the indoor unit.

#### Connection

- A. The wired controller shall connect to an indoor unit using the supplied 3-pin cable.
- B. 2 wired controls shall be connectable to one indoor unit.
- C. A single wired controller shall be able to connect up to 16 of the same model type of indoor units. The connected units shall work in unison as a single zone.

#### Compatibility

- A. The wired controller shall be compatible with all Haier indoor units.

#### Warranty

- A. The warranty shall also cover all defects in workmanship or material for the unit accessory for a period of 1 year. Haier will provide a new or refurbished controller, at its sole discretion.

#### Features

- A. The wired controller shall have large physical buttons for easy operation.
- B. The wired controller shall have a power button, a mode button (heat, cool, dry), a fan speed button, a temperature up button and a temperature down button.
- C. The wired controller shall be capable of setting a precise temperature of  $\pm 1^{\circ}\text{F}$  ( $\pm 0.5^{\circ}\text{C}$ ).
- D. The wired controller shall have a backlight.
- E. The wired controller shall have vertical and horizontal louver control.
- F. The wired controller shall have a child lock function.
- G. The wired controller shall display either Fahrenheit or Celsius.
- H. The wired controller shall have the ability to display indoor ambient temperature.
- I. The wired controller shall have a Clean Filter reminder.
- J. The wired controller shall display error codes.
- K. The wired controller shall have an infrared receiver that can receive commands from a Haier hand-held remote control.

## 8.4 Indoor Unit Accessory Compatibility Table

|                   | Model Number | Remote Controllers |            |            | Wired Controller | Refrigerant Detection Sensor (RDS) |
|-------------------|--------------|--------------------|------------|------------|------------------|------------------------------------|
|                   |              | WJ26X35395         | WJ26X35813 | WJ26X35396 | GACT17B          | UALS01A                            |
| Standard Highwall | GS09WB2BEA   | ●                  |            |            | ○                | ○                                  |
|                   | GS12WB2BEA   | ●                  |            |            | ○                | ○                                  |
|                   | GS18WB2BEA   | ●                  |            |            | ○                | ○                                  |
|                   | GS24WB2BEA   | ●                  |            |            | ○                | ○                                  |

● = Included    ○ = Required, sold separately    ○ = Optional; sold separately

See Outdoor Unit Accessory Compatibility Table for 5" Central Controller compatibility

*[This page intentionally left blank.]*



**GE APPLIANCES**  
*a Haier company*

**AIR&WATER**  
SOLUTIONS

# Ductless Technical Support

**Phone: 866.814.3633**

**Email: [HVACSupport@GEAppliances.com](mailto:HVACSupport@GEAppliances.com)**

**Online: [GEAppliancesAirAndWater.com](http://GEAppliancesAirAndWater.com)**



Pub No. TBD

Rev. 02-18-26

©Copyright 2026 GE Appliances, a Haier Company.  
Our continued commitment to quality products may  
mean a change in specifications without notice.