


Applicable Rack Configurations
TRW03CU + TRW02CU
TRS03CUIL + TRS02CUIL
TRS03CUILW + TRS02CUILW
TRS06CU + TRS04CU
TRS05CU + TRS04CU

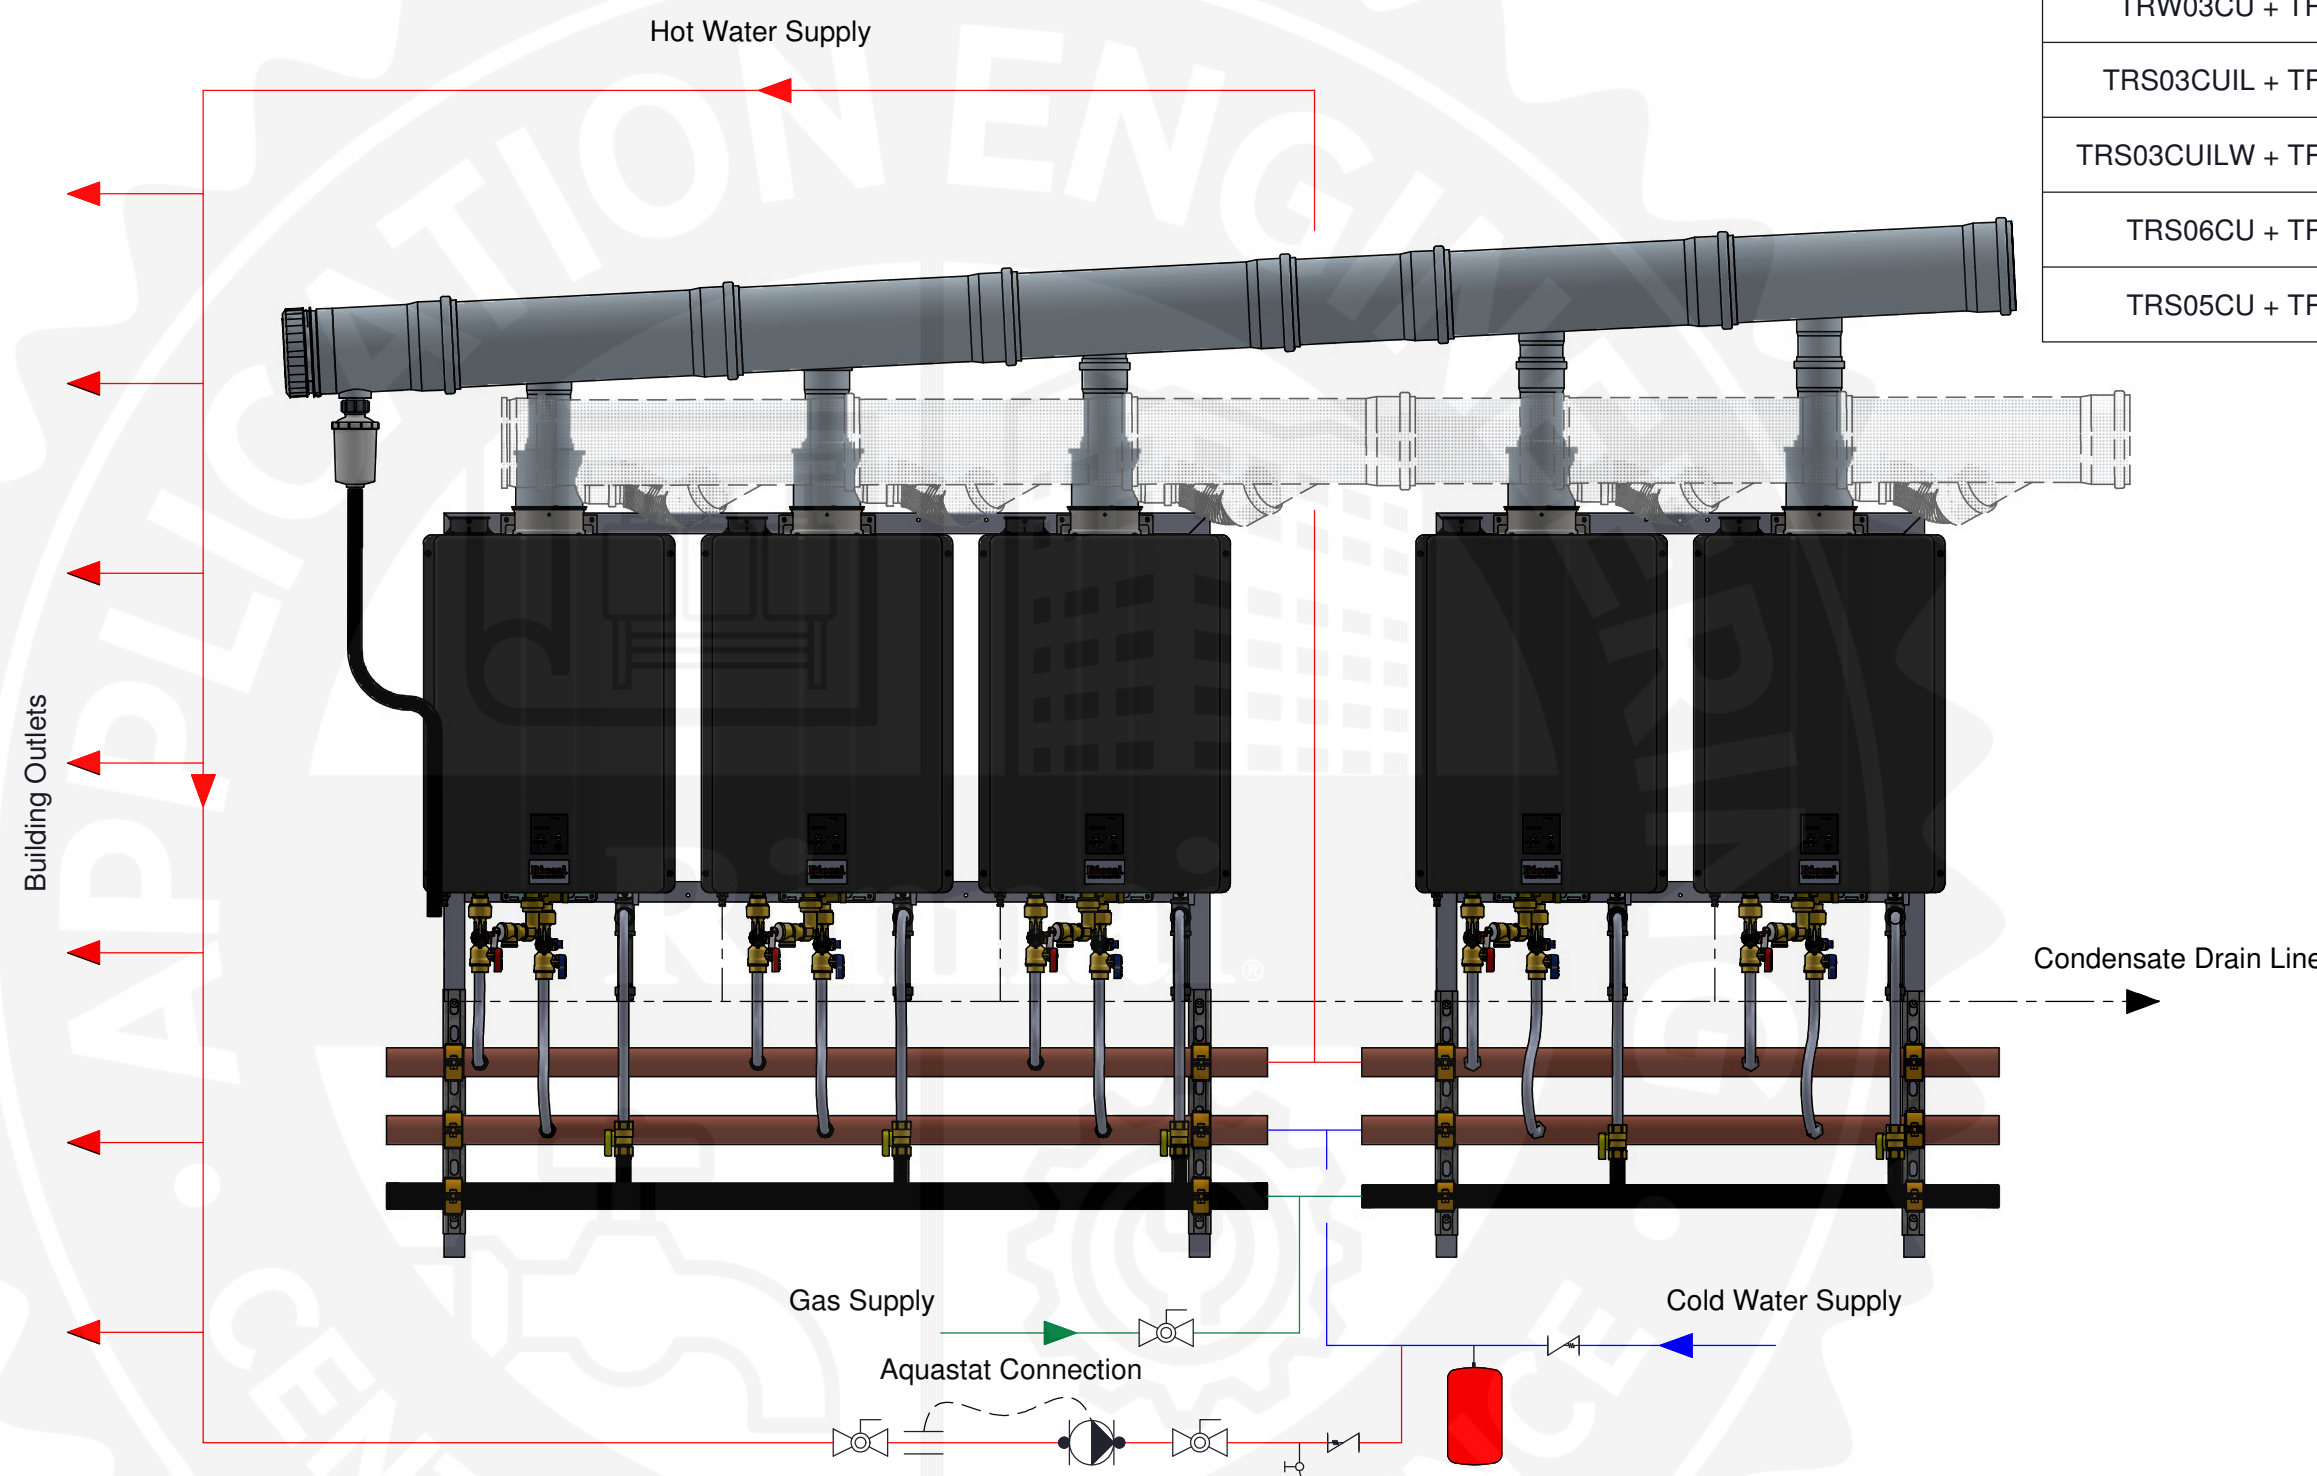

- Note:**
- Condensate piping shall be CPVC or PVC material and shall not be smaller than the drain connection on the appliance.
 - Components of the condensate drainage shall be CPVC or PVC material. All components shall be selected for the pressure and temperature rating of the installation.
 - Where the drain pipes from more than one unit are manifolded together for condensate drainage, the pipe or tubing shall be sized in accordance with an approved method as dictated by local codes.
 - Condensate must be disposed of according to local codes.
 - Pump should be controlled by an Aquastat, Timer or Combination Aquastat and Timer.
 - Pump should be sized to maintain circulation loop temperature.
 - Pump should be sized to overcome the pressure loss through the tankless water heater, supply, and return plumbing. Reference the Rinnai Hot Water System Design Manual for pump sizing guidelines.
 - Pump should be of bronze or stainless construction.
 - Reference the Common Vent Installation Manual for common vent options. Air intake shown for direct vent installations only.
 - Reference Water Heater IO Manual for cascading instructions.

- Ensure tankless heaters are installed in parallel to maximize system output.
- Contact Application Engineering Center of Excellence if alternate piping arrangements will be considered.
- Balancing of hot water risers may be necessary after installation to ensure consistent hot water delivery.

THIRD ANGLE PROJECTION

RINNAI AMERICA CORPORATION
103 INTERNATIONAL DRIVE
PEACHTREE CITY, GA 30269
1-800-621-9419

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF RINNAI AMERICA. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF RINNAI AMERICA IS PROHIBITED.

This is not an engineering drawing; it is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

UNLESS OTHERWISE SPECIFIED:		NAME	DATE
TOLERANCES: Sheet Metal X.XX = ±0.030 X.XXX = ±0.010 Fraction = ±1/32 Angle = ±1.0°		DRAWN	AB 11.13.2018
MACHINED X.XXX = ±0.005 Angle = ±0.010°		CHECKED	SH 12.15.2018
INTERPRET GEOMETRIC TOLERANCING PER:		ENG APPR.	RS 12.15.2018
MATERIAL		COMMENTS:	
FINISH			
DO NOT SCALE DRAWING			

Rinnai		
TITLE: Systems Design Manual		
Tankless Rack System		
5-10 Unit InLine Back 2 Back Circulation		
SIZE	DWG. NO.	REV
B	TRSCU-IL5BB10-CIRC	
SCALE: NTS	WEIGHT:	SHEET 1 OF 1